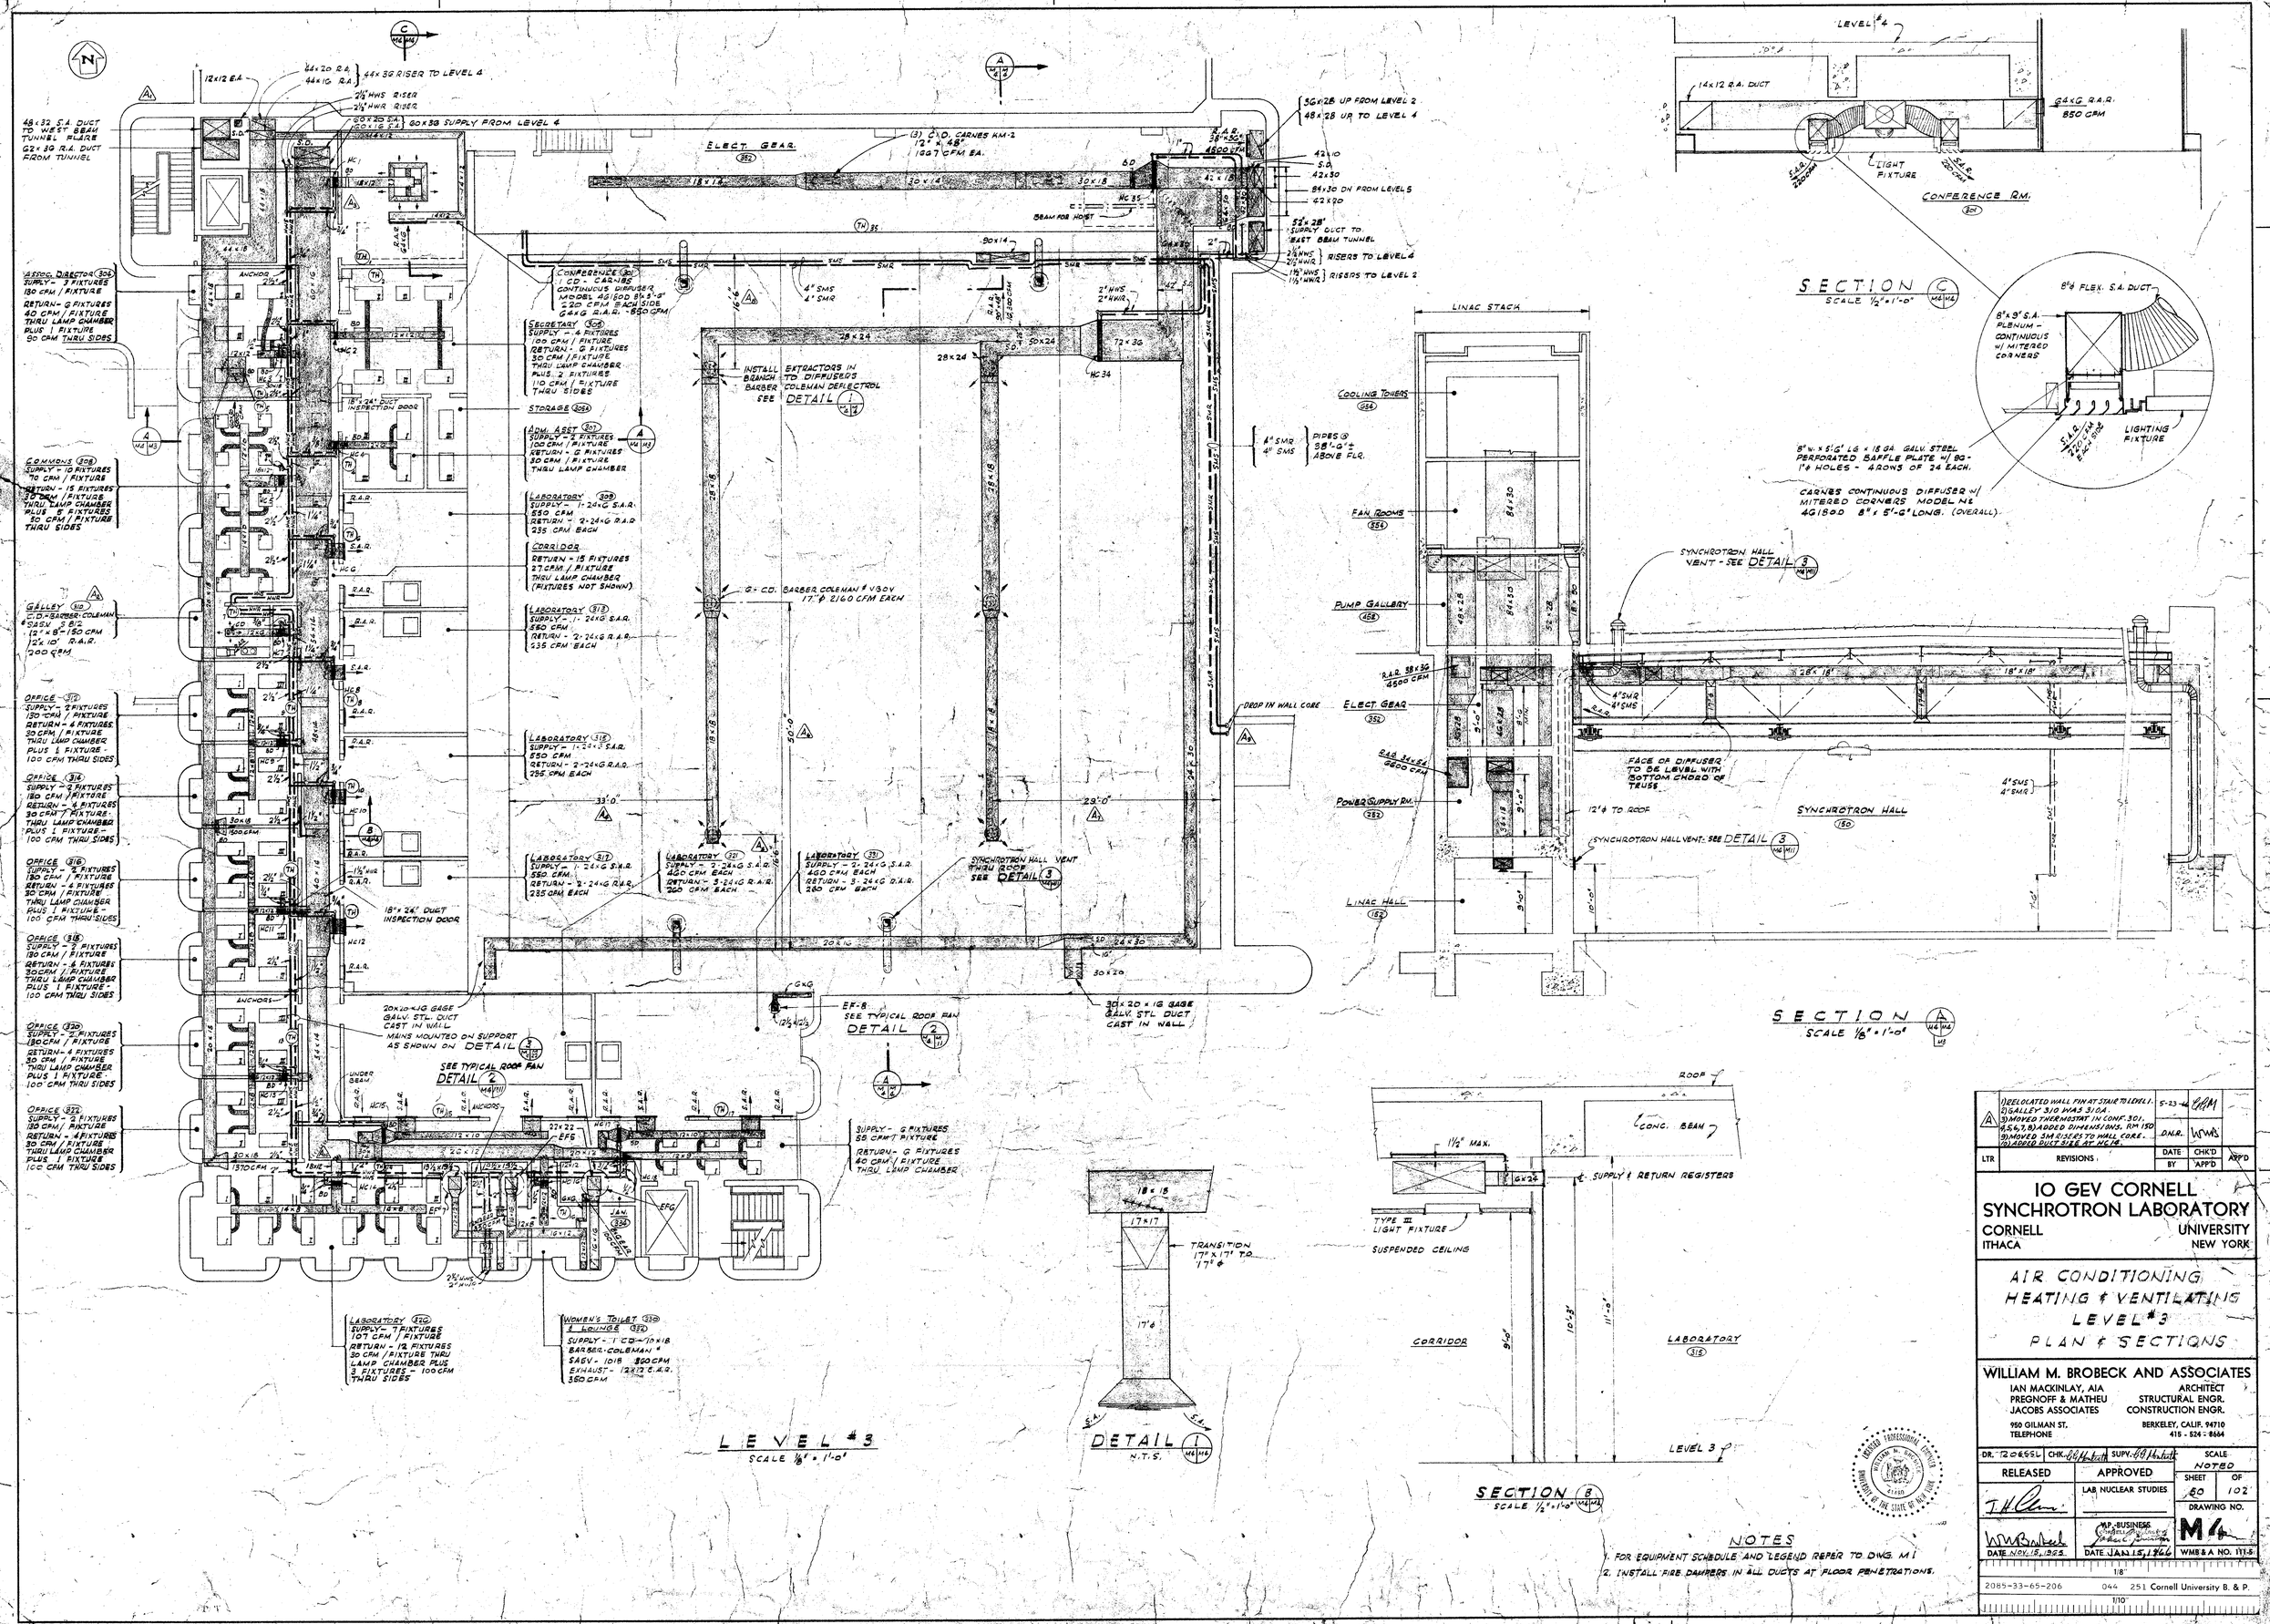

NOTES

1. FOR EQUIPMENT SCHEDULE AND LEGEND REFER TO DWG. M1
2. INSTALL FIRE DAMPERS IN ALL DUCTS AT FLOOR PENETRATIONS.

LTR	REVISIONS	DATE	BY	CHK'D	APP'D
A	1) RELOCATED WALL FIN AT STAIR TO LEVEL 1. 2) GALLEY 310 MAS 31CA. 3) MOVED THERMOSTAT IN CONF. 301. 4,5,6,7,8) ADDED DIMENSIONS. RM 150 9) MOVED SM DIFFUSERS TO WALL CORE. 10) ADDED DUCT SIZE AT MC14.	5-23-66	DNR	WMB	

10 GEV CORNELL SYNCHROTRON LABORATORY

CORNELL UNIVERSITY
ITHACA NEW YORK

AIR CONDITIONING
HEATING & VENTILATING
LEVEL #3
PLAN & SECTIONS

WILLIAM M. BROBECK AND ASSOCIATES
ARCHITECT
IAN MACKINLAY, AIA
PREGNOFF & MATHEU
JACOBS ASSOCIATES
STRUCTURAL ENGR.
CONSTRUCTION ENGR.
950 GILMAN ST.
BERKELEY, CALIF. 94710
TELEPHONE 415 - 524 - 8664

DR. T20655L	CHK.	SUPV.	SCALE NOTED
RELEASED	APPROVED		SHEET 60 OF 102
	LAB NUCLEAR STUDIES		DRAWING NO. M4
DATE NOV. 15, 1965	MP BUSINESS DATE JAN 15, 1966		WMB & A NO. 111-5

1/8"

2085-33-65-206 044 251 Cornell University B. & P.

1/10"