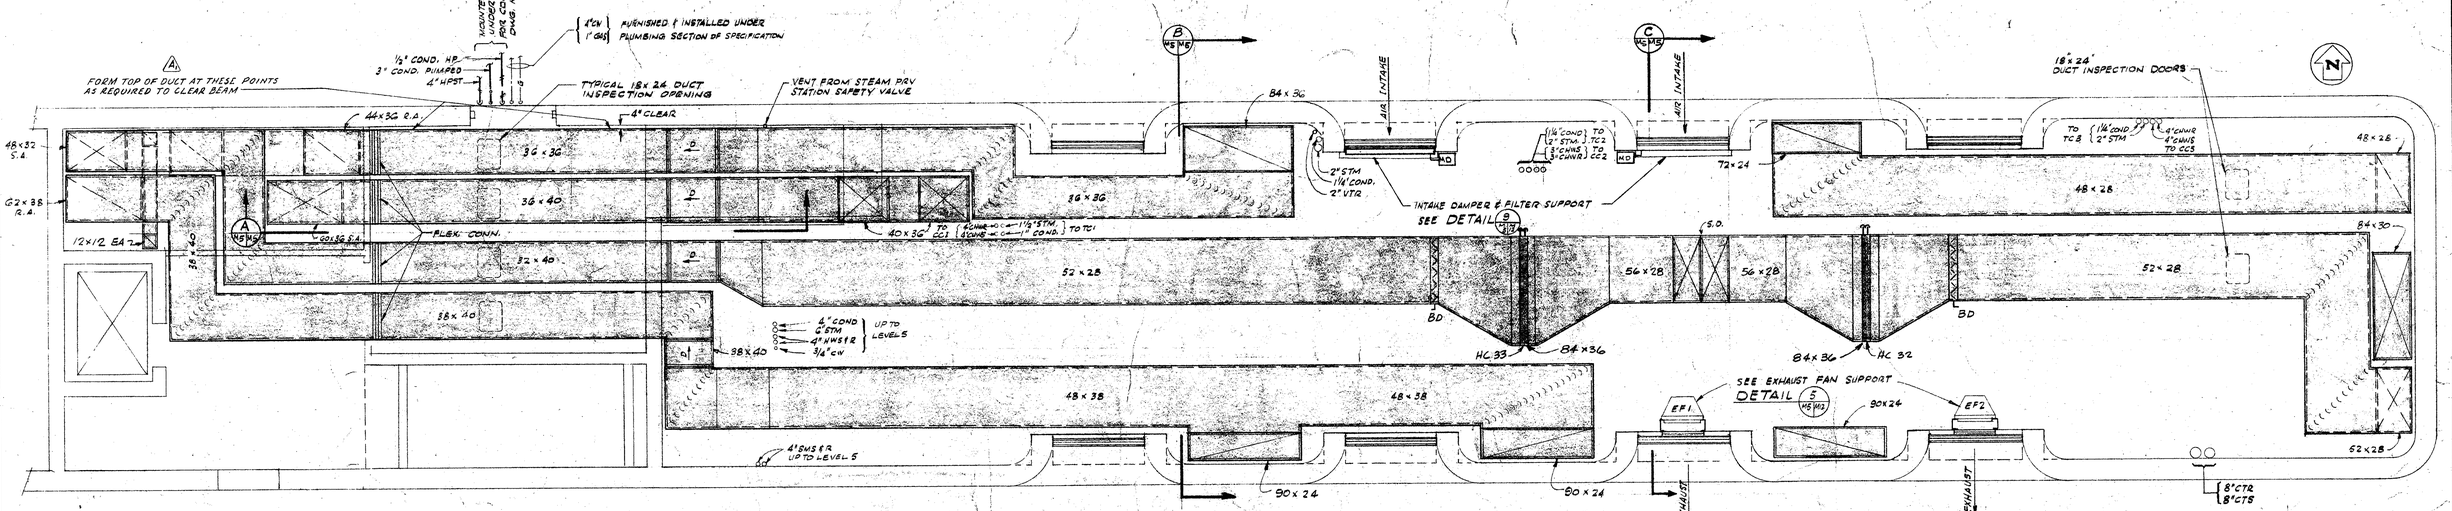

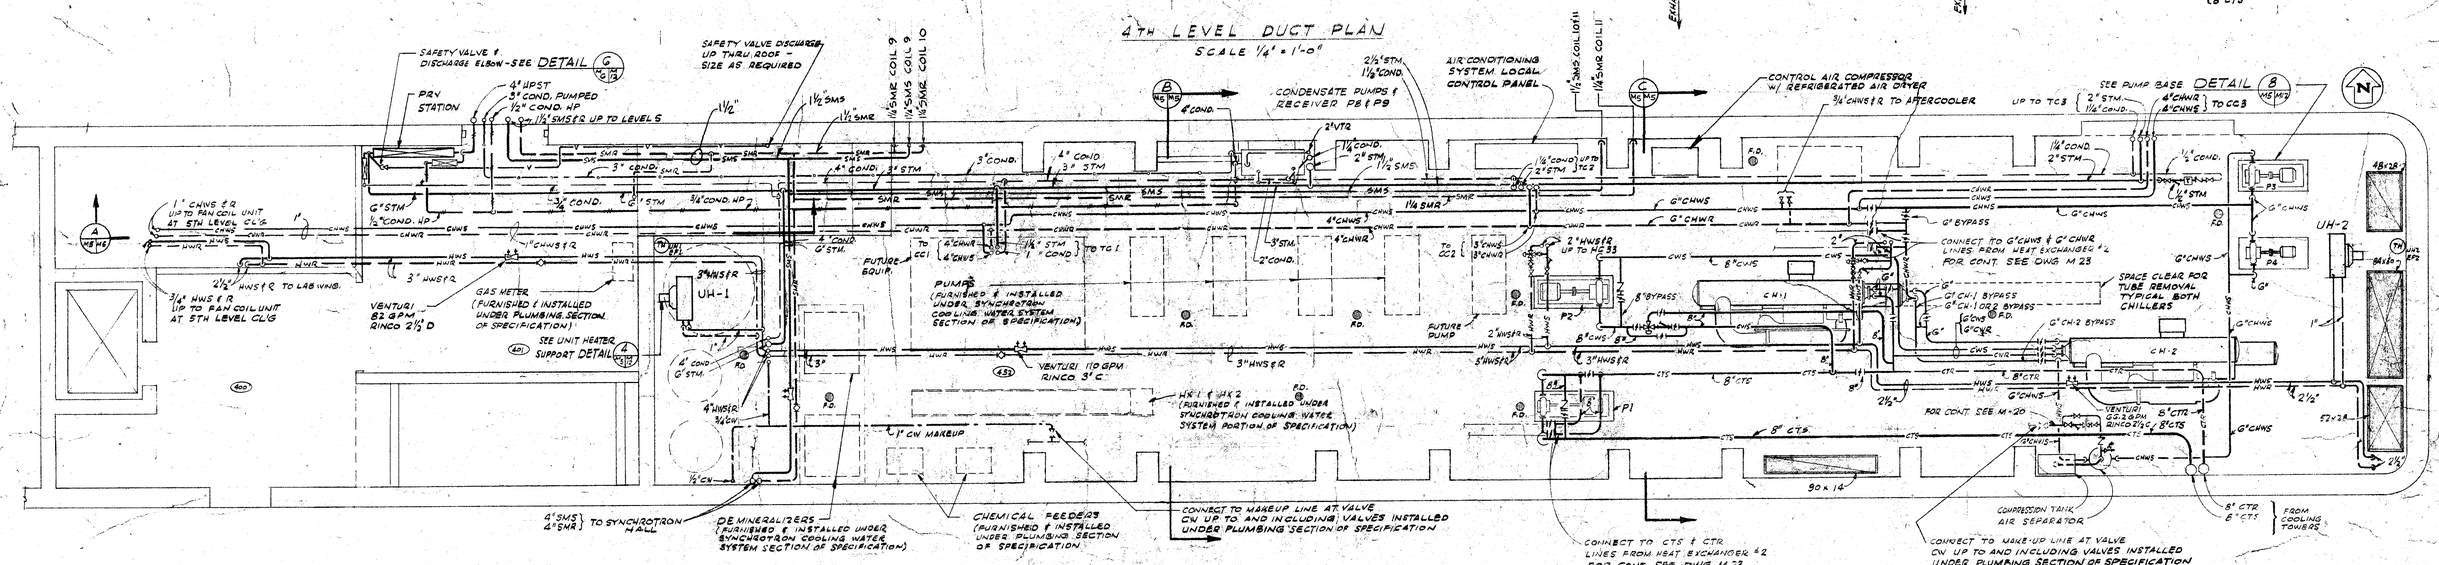

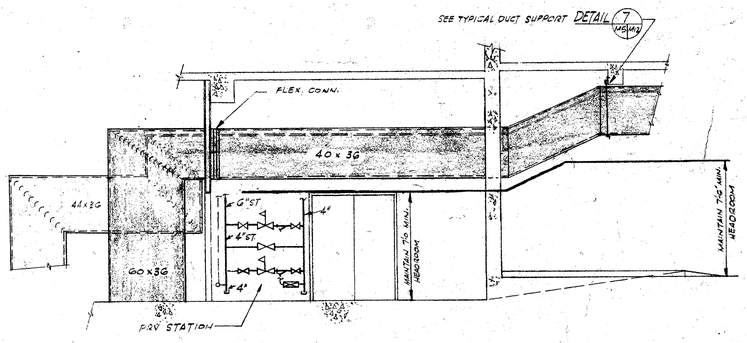

SECTION A
SCALE 1/4" = 1'-0"

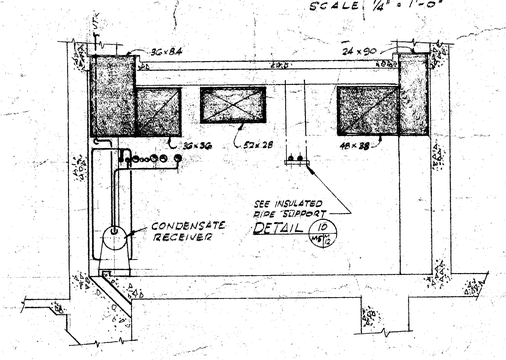

SECTION B
SCALE 1/4" = 1'-0"

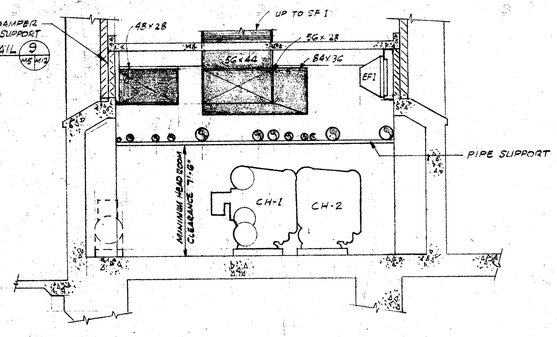

SECTION C
SCALE 1/4" = 1'-0"

NOTE

1. FOR EQUIPMENT SCHEDULE AND LEGEND REFER TO DWG M1
2. REFER TO FLOW DIAGRAMS DWGS. M8 & M9 FOR ALL VALVES, GAGES, ETC. REQUIRED IN PIPING.
3. INSTALL FIRE DAMPERS IN ALL DUCTS AT FLOOR PENETRATIONS.

LTR	REVISIONS	DATE	CHK'D	APP'D
A	ADDED NOTE TO DUCT IN 4TH LEVEL DUCT PLAN.	5-23-66	GBM	
		DWR.	WWB	

10 GEV CORNELL SYNCHROTRON LABORATORY

CORNELL UNIVERSITY
ITHACA NEW YORK

AIR CONDITIONING HEATING & VENTILATING LEVEL #4 PLANS & SECTIONS

WILLIAM M. BROBECK AND ASSOCIATES
ARCHITECT
IAN MACKINLAY, AIA
PREGNOFF & MATHEU — STRUCTURAL ENGR.
JACOBS ASSOCIATES — CONSTRUCTION ENGR.
950 GILMAN ST. BERKELEY, CALIF. 94710
TELEPHONE 415 - 524 - 8664

DR. ROESSL	CHK. GBMontalti	SUPV. GBMontalti	SCALE 1/4" = 1'-0"
RELEASED	APPROVED		SHEET 51 OF 102
T.H. Clem	LAB NUCLEAR STUDIES		DRAWING NO. M5
DATE NOV. 15, 1965	V.P.-BUSINESS	DATE JAN. 16, 1966	WMB & A NO. 133-5

2085-33-65-207 044 252 Cornell University B. & P.