
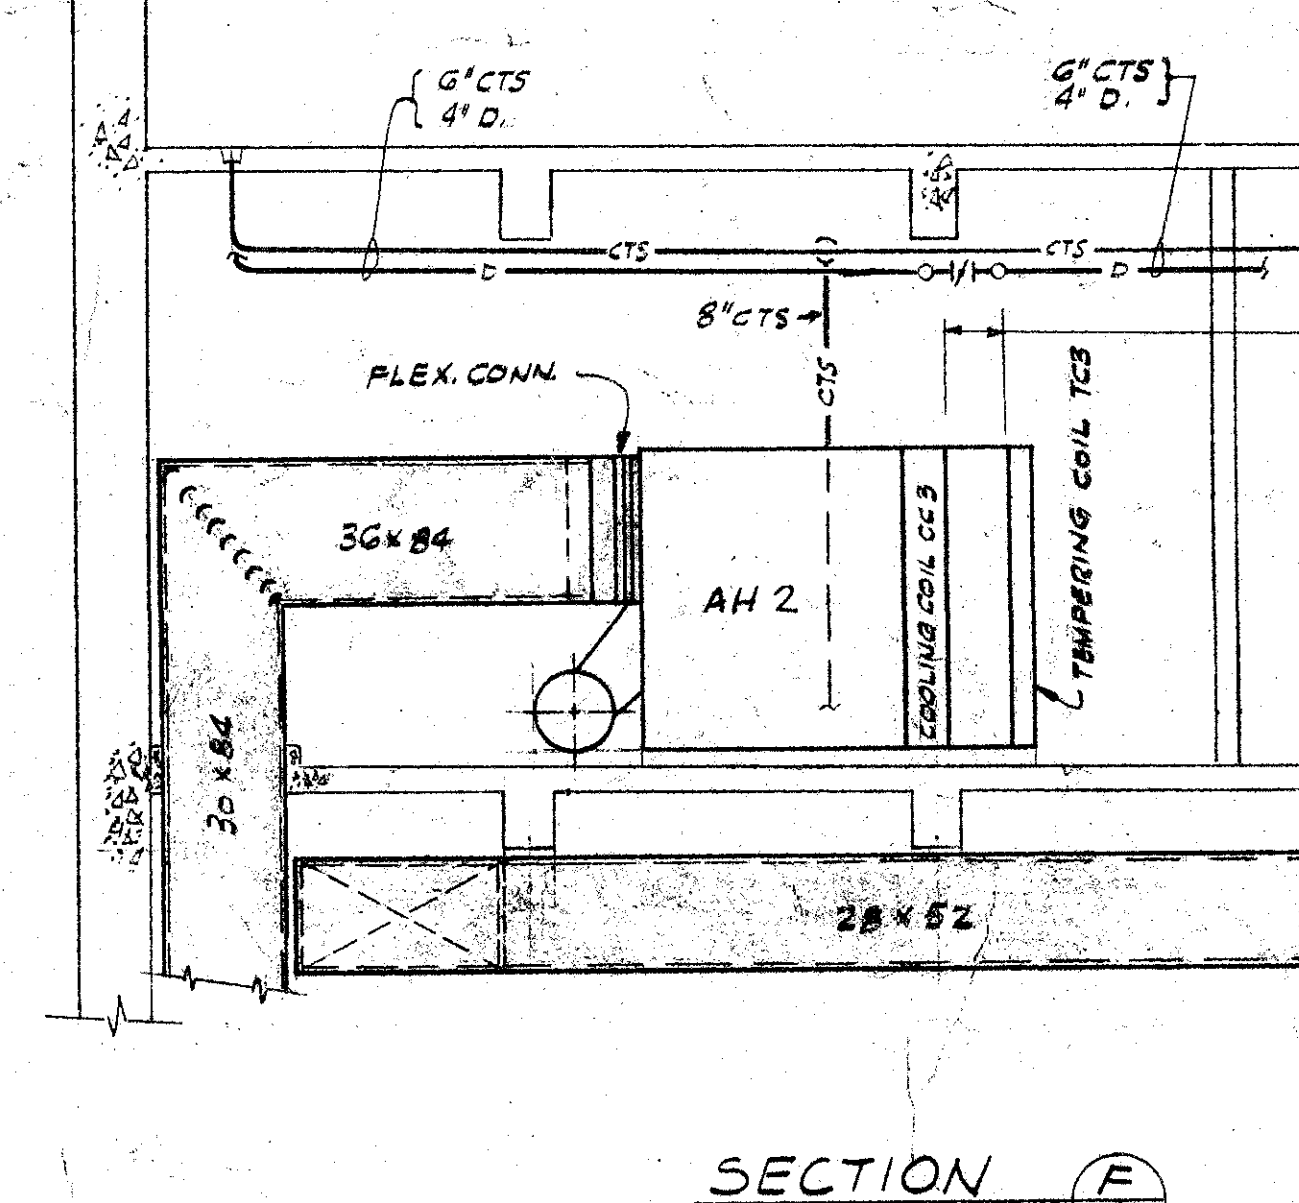
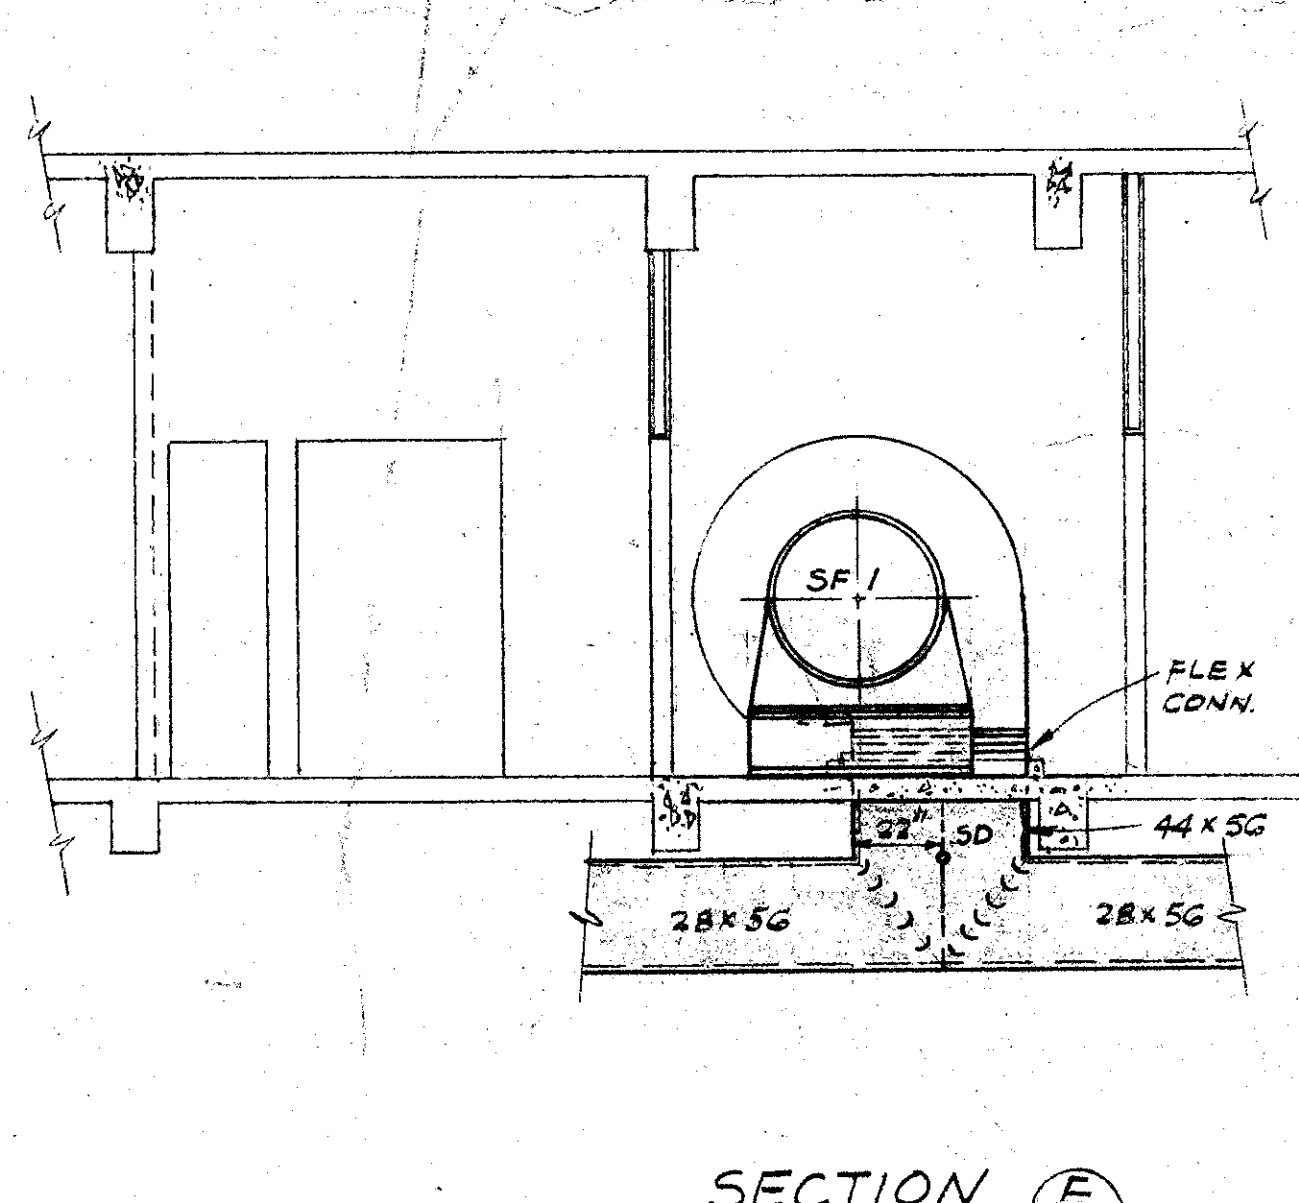
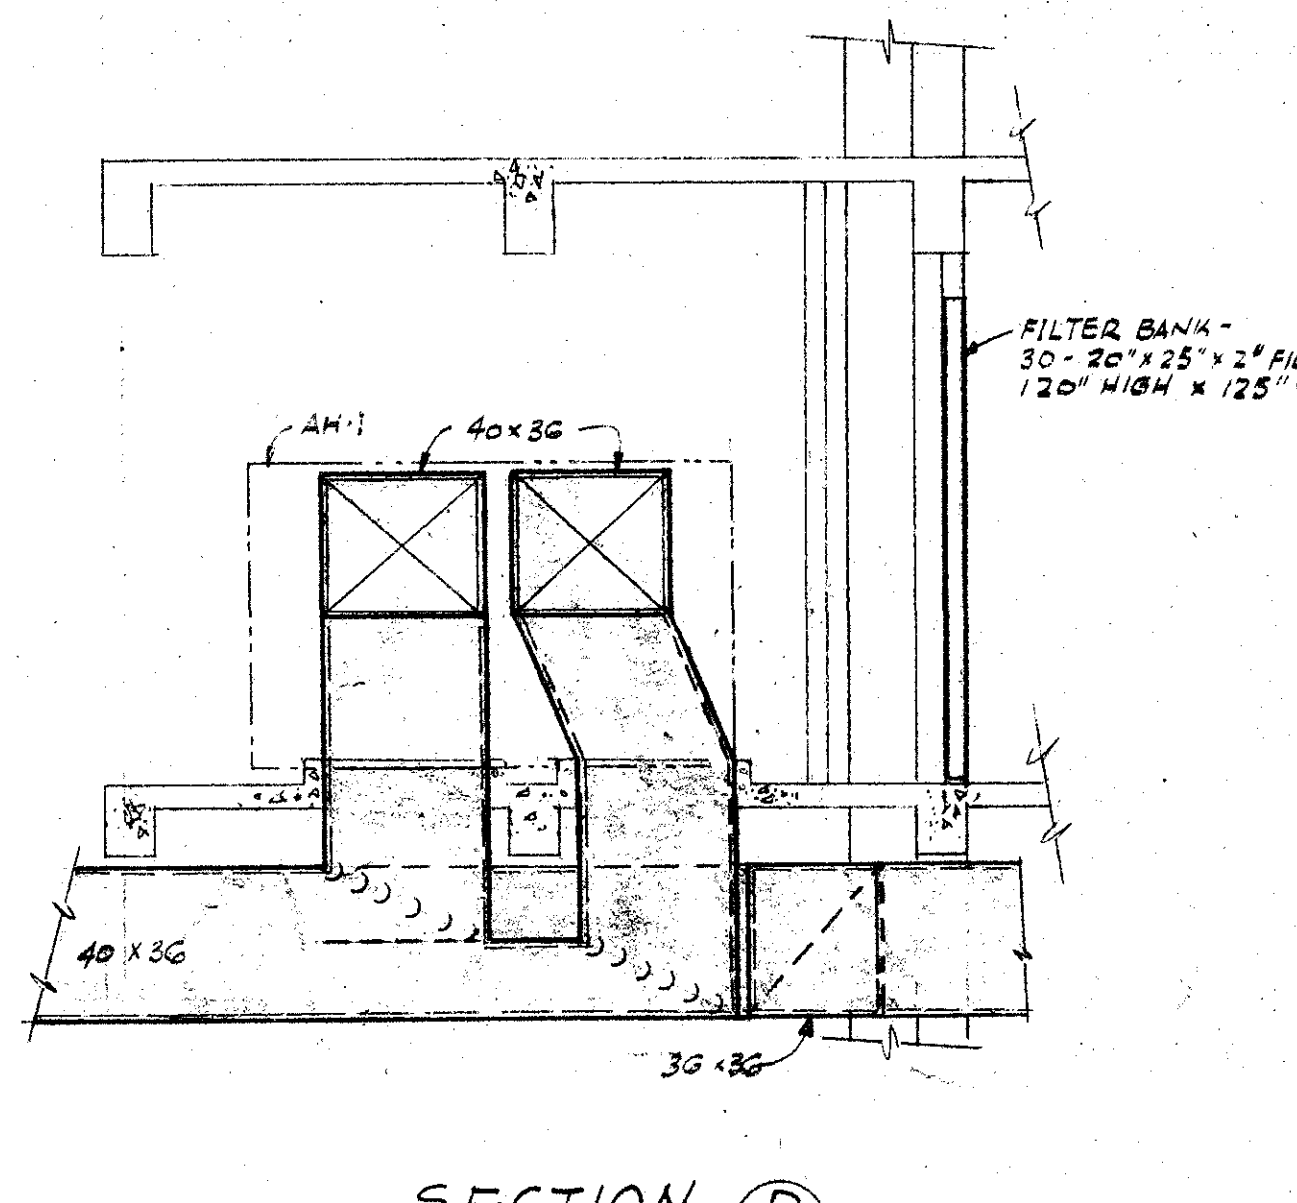
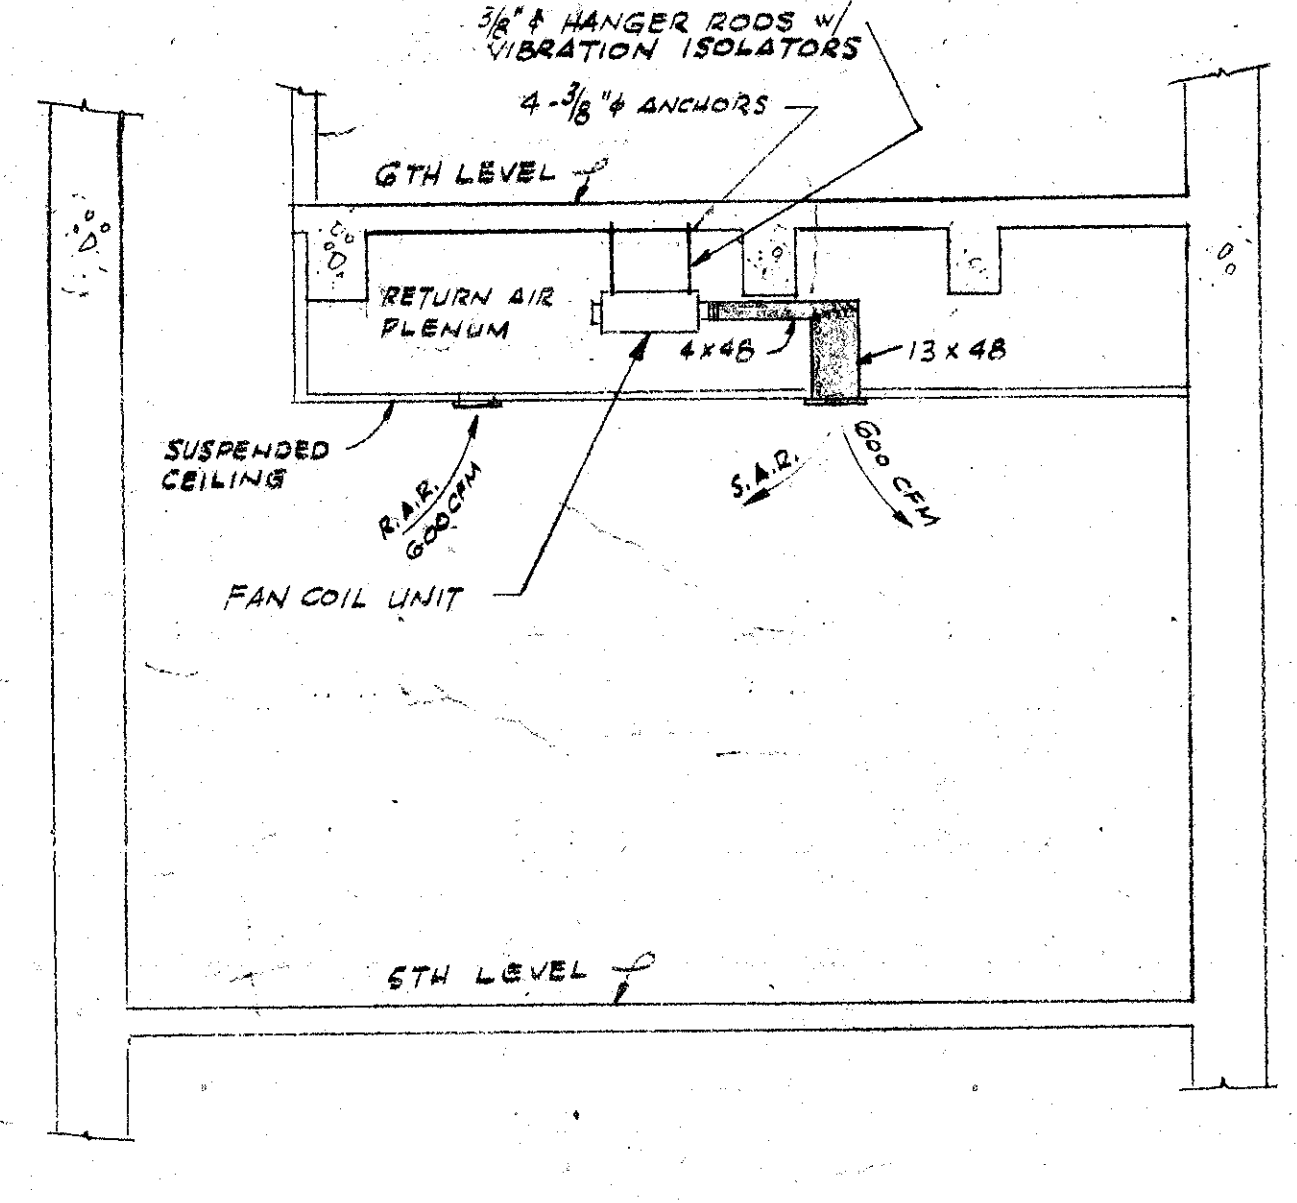
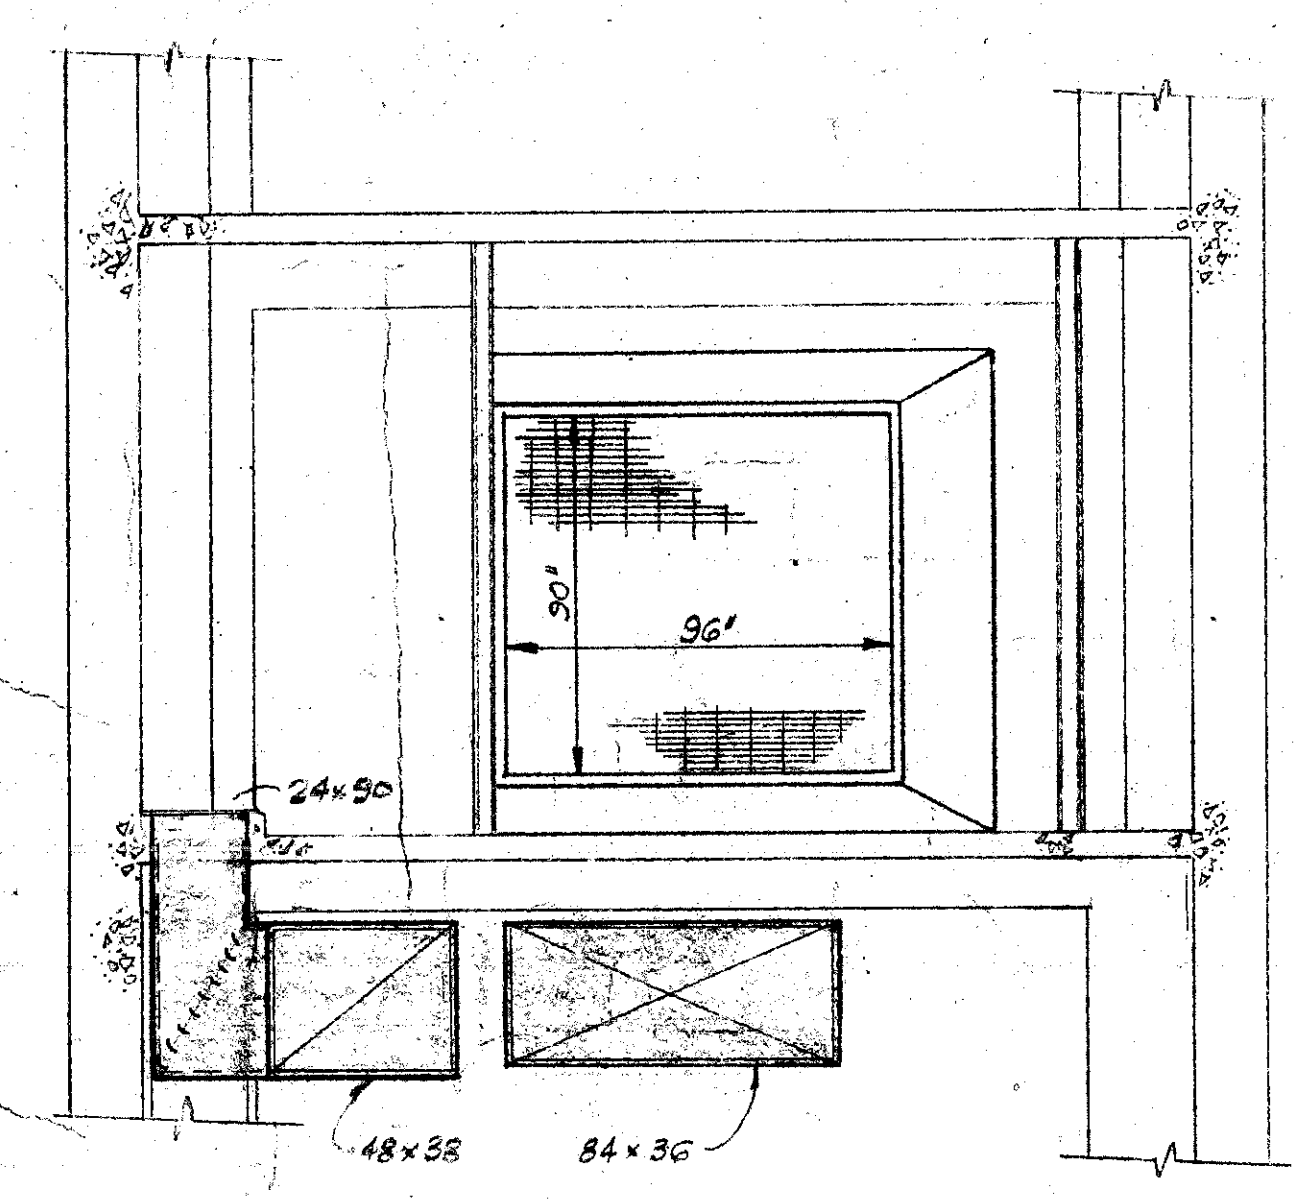
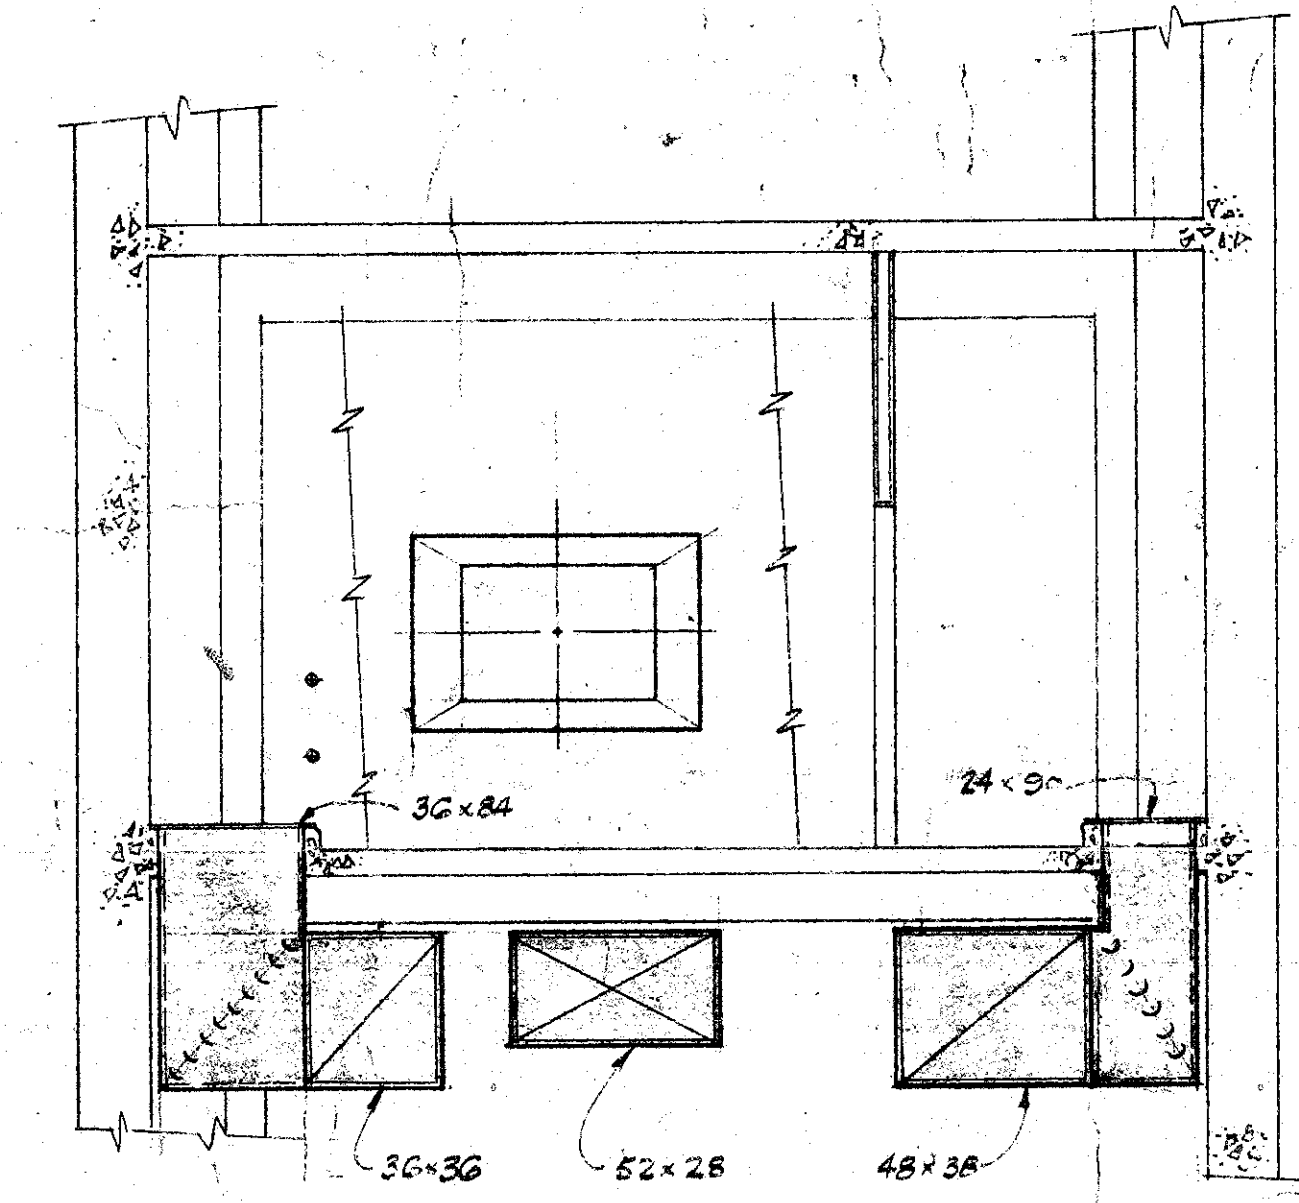
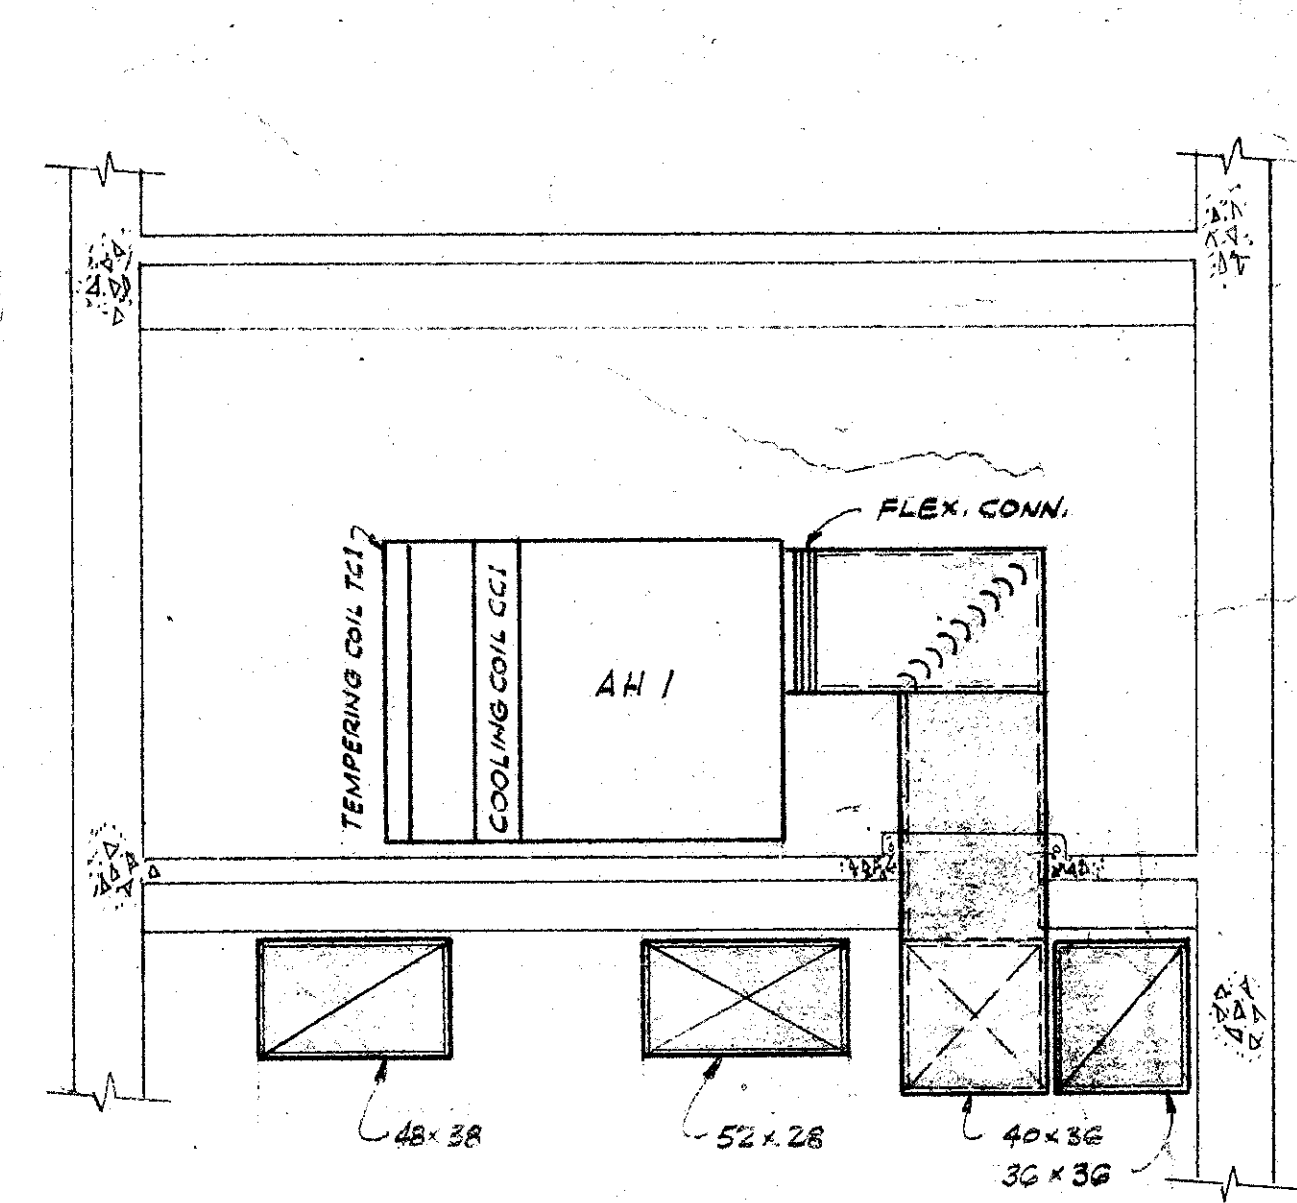


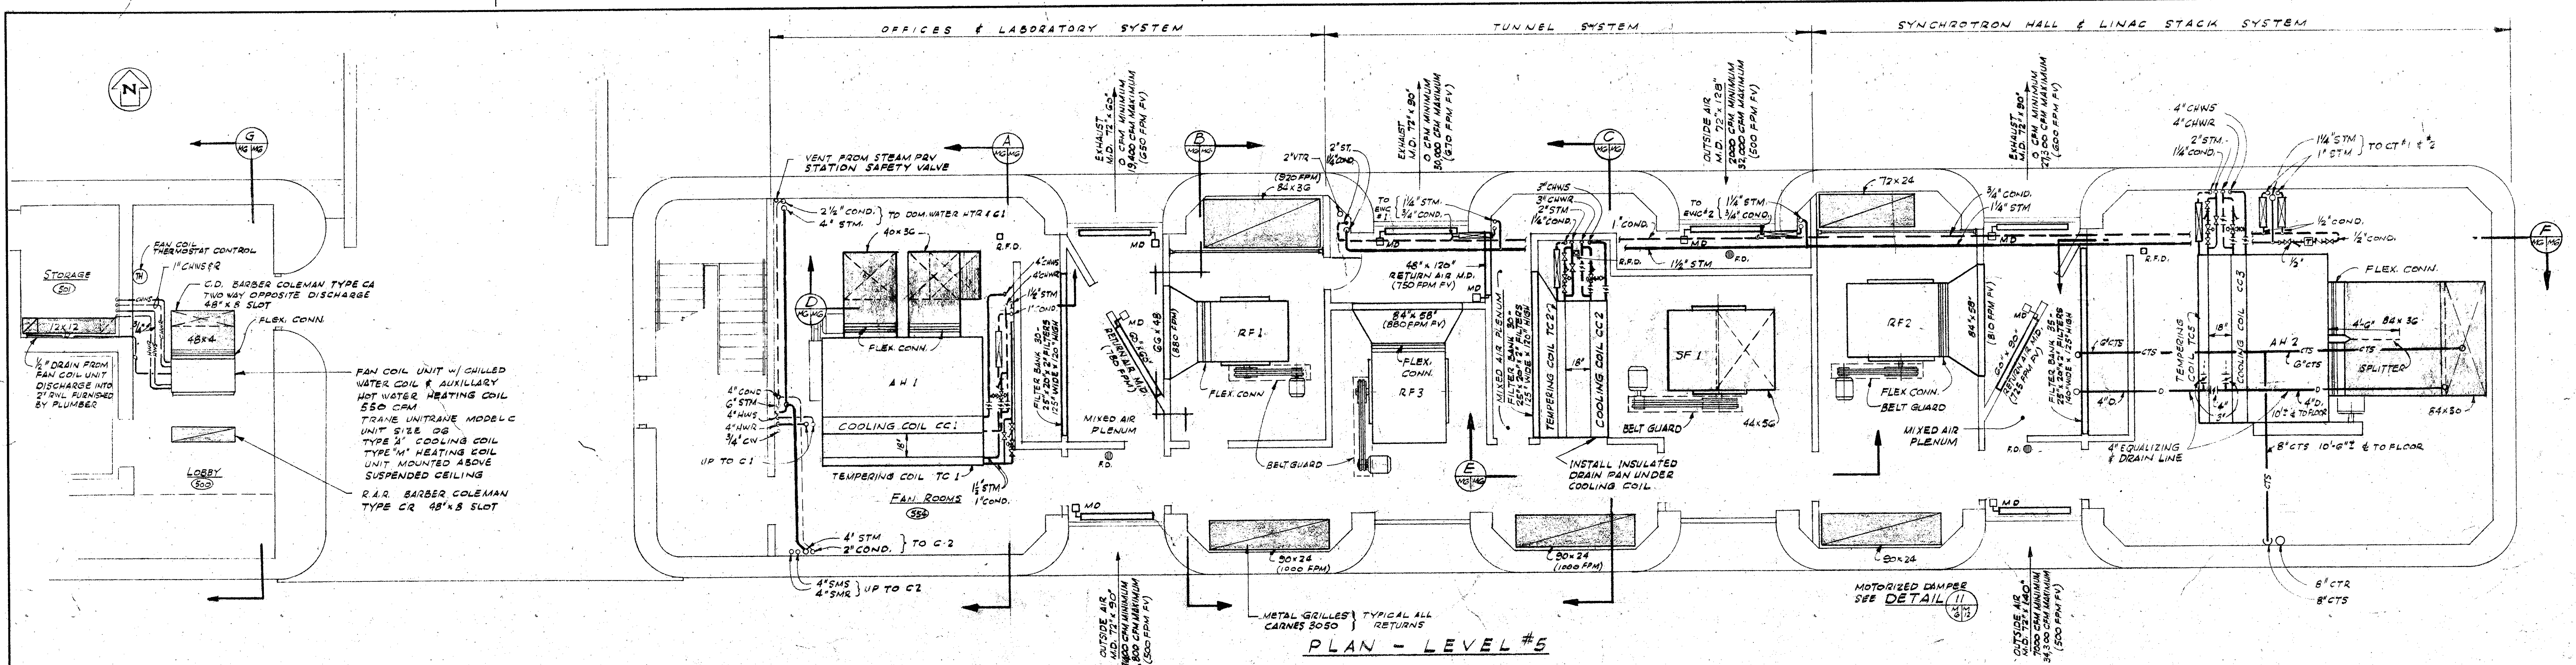

NOTES

1. FOR EQUIPMENT SCHEDULE AND LEGEND REFER TO DWG. M1.
2. RUN 1" DRAIN PIPES FROM ALL COOLING COIL DRAIN PANS & DISCHARGE TO NEAREST FLOOR DRAIN. INSTALL TRAP IN DRAIN.

LTR	REVISIONS	DATE	CHK'D	APP'D
IO GEV CORNELL SYNCHROTRON LABORATORY CORNELL UNIVERSITY ITHACA, NEW YORK				
AIR CONDITIONING HEATING & VENTILATING LEVEL #5 PLAN & SECTIONS				
WILLIAM M. BROBECK AND ASSOCIATES IAN MACKINLAY, AIA ARCHITECT PREGOROFF & MATHEU STRUCTURAL ENGR. JACOBS ASSOCIATES CONSTRUCTION ENGR. 950 GILMAN ST. BERKELEY, CALIF. 94710 TELEPHONE 415 - 824 - 8664				
DR. ROESSL	CHK'D	SUPV.	SCALE	
RELEASED	APPROVED	1/4" = 1'-0"		
I.H. [Signature]	LAB NUCLEAR STUDIES	SHEET	OF	
W.M. [Signature]	DATE JAN 15, 1966	52	102	
DATE JAN 15, 1966		DRAWING NO.		
		M.G.		
		WMB & NO. 111.5		
		1/10		
		2085-33-65-208 044 253 Cornell University B. & P.		