
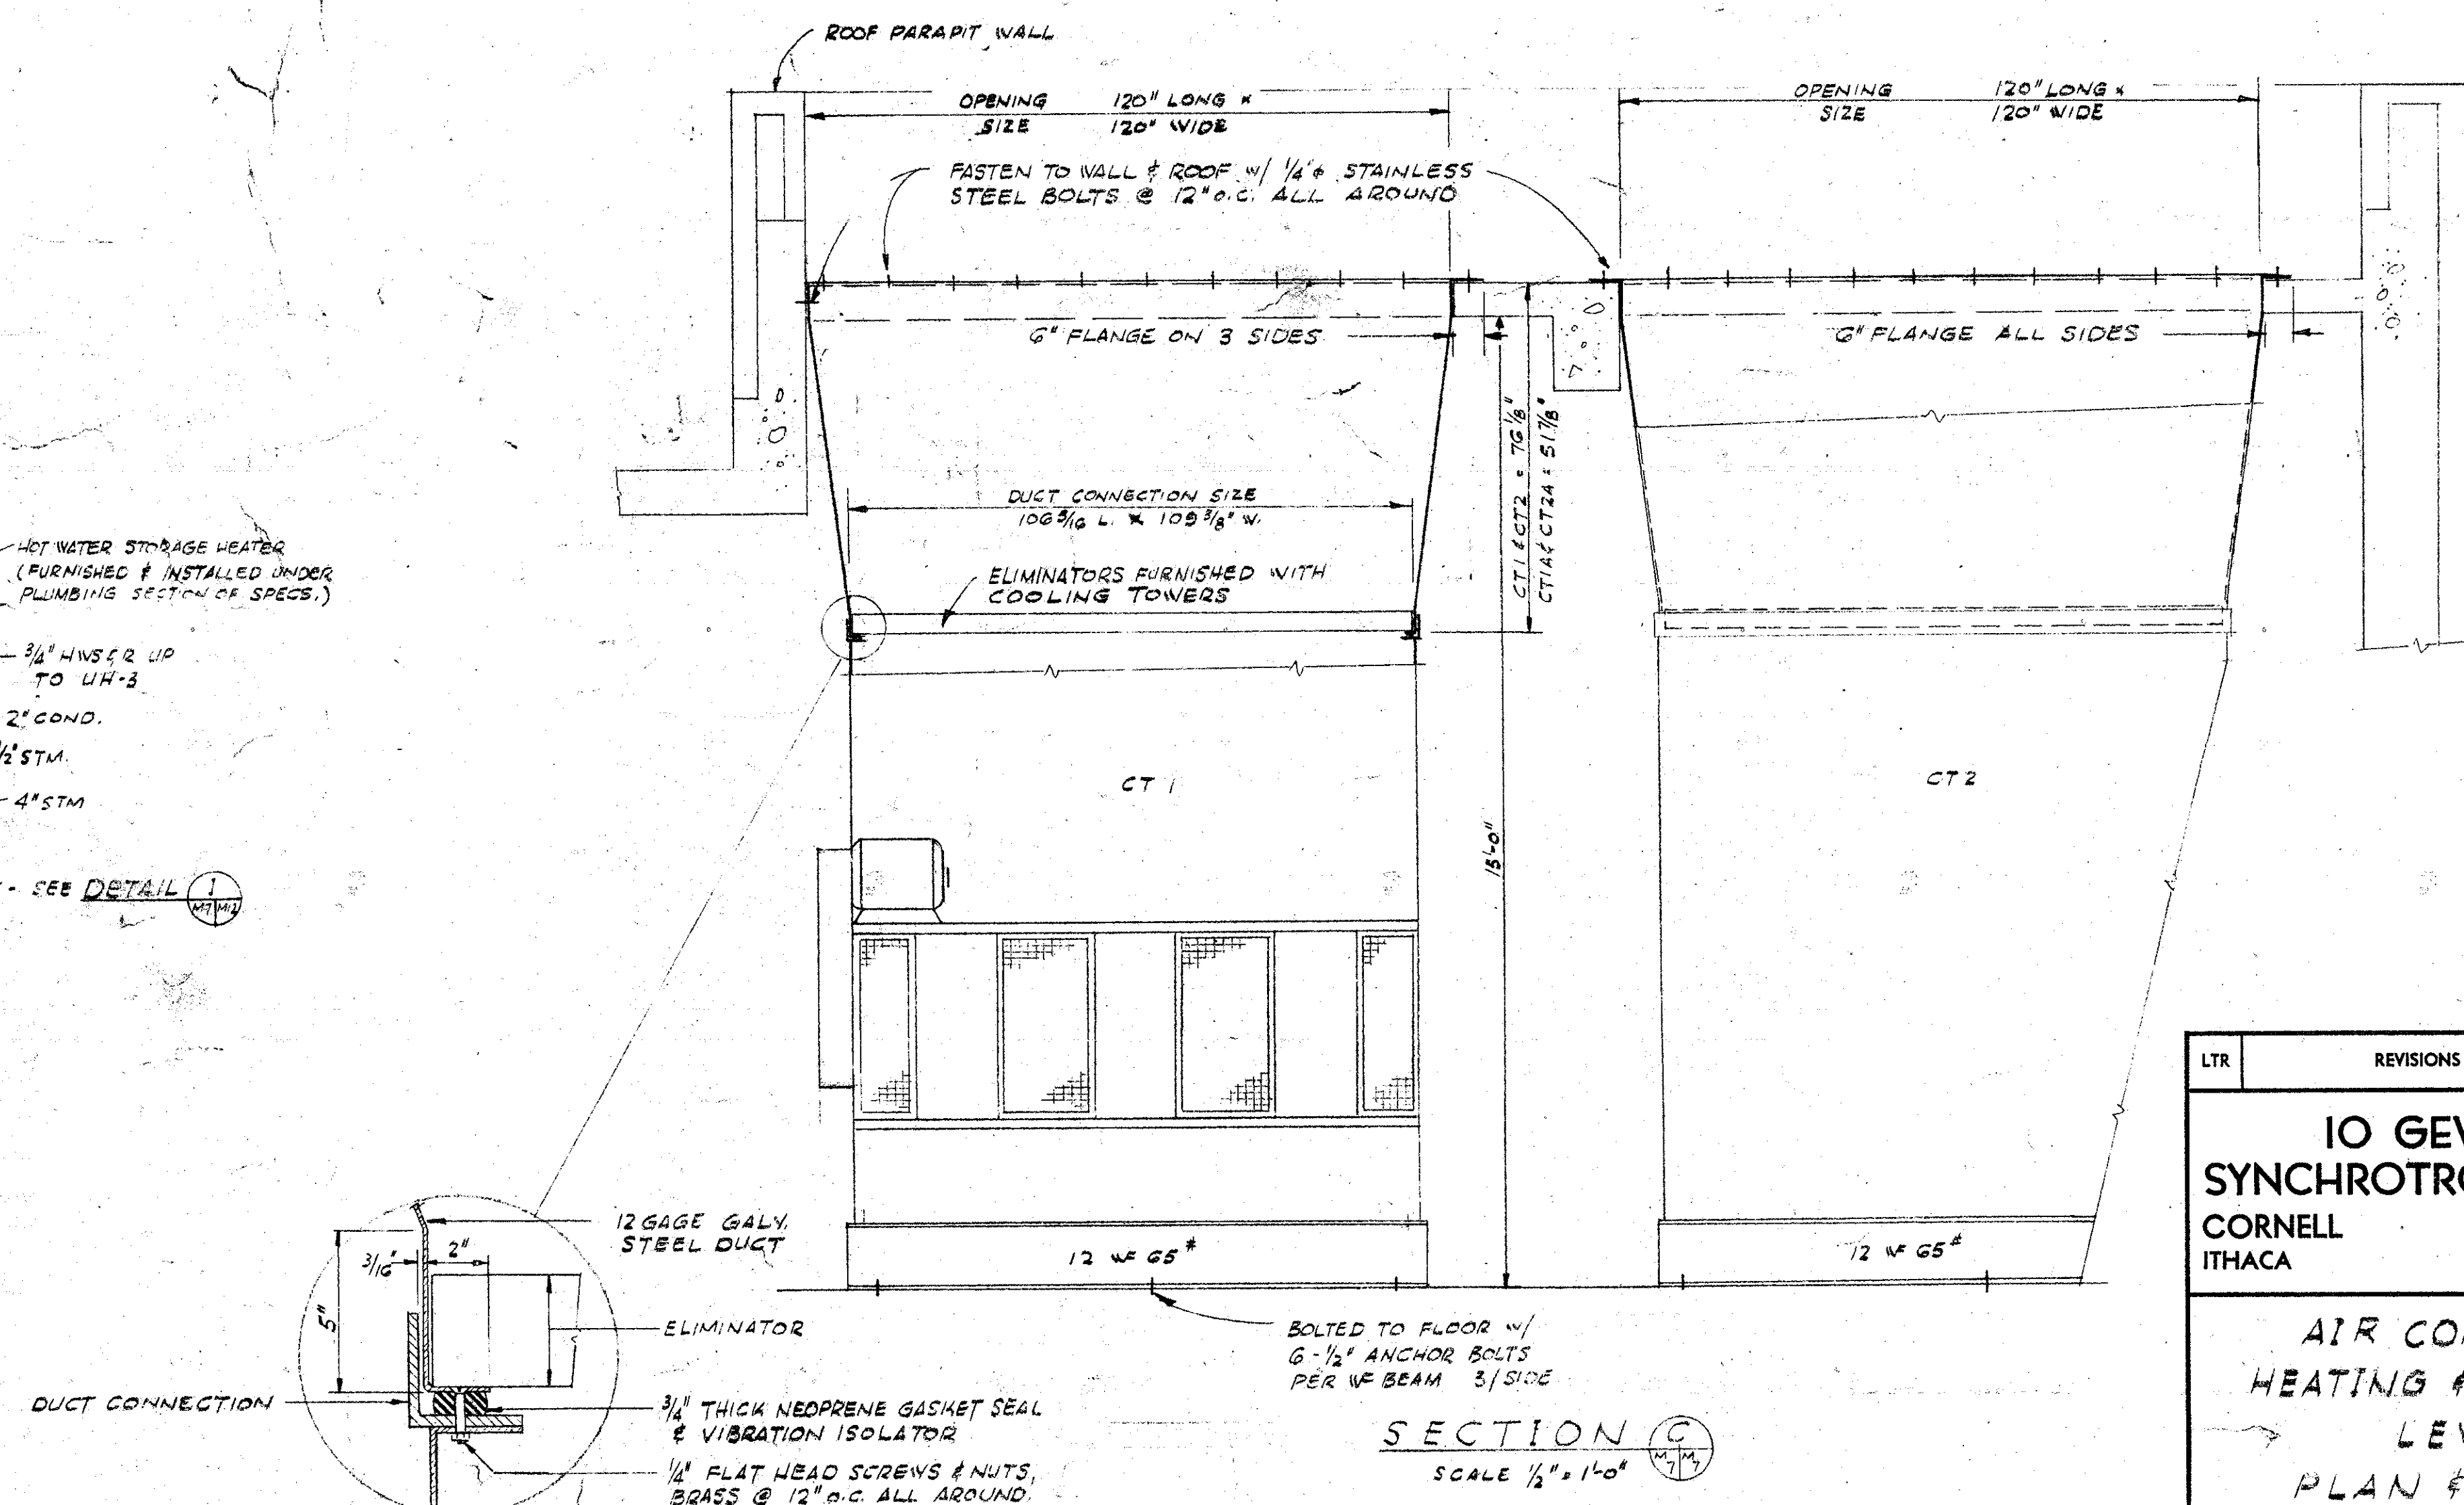
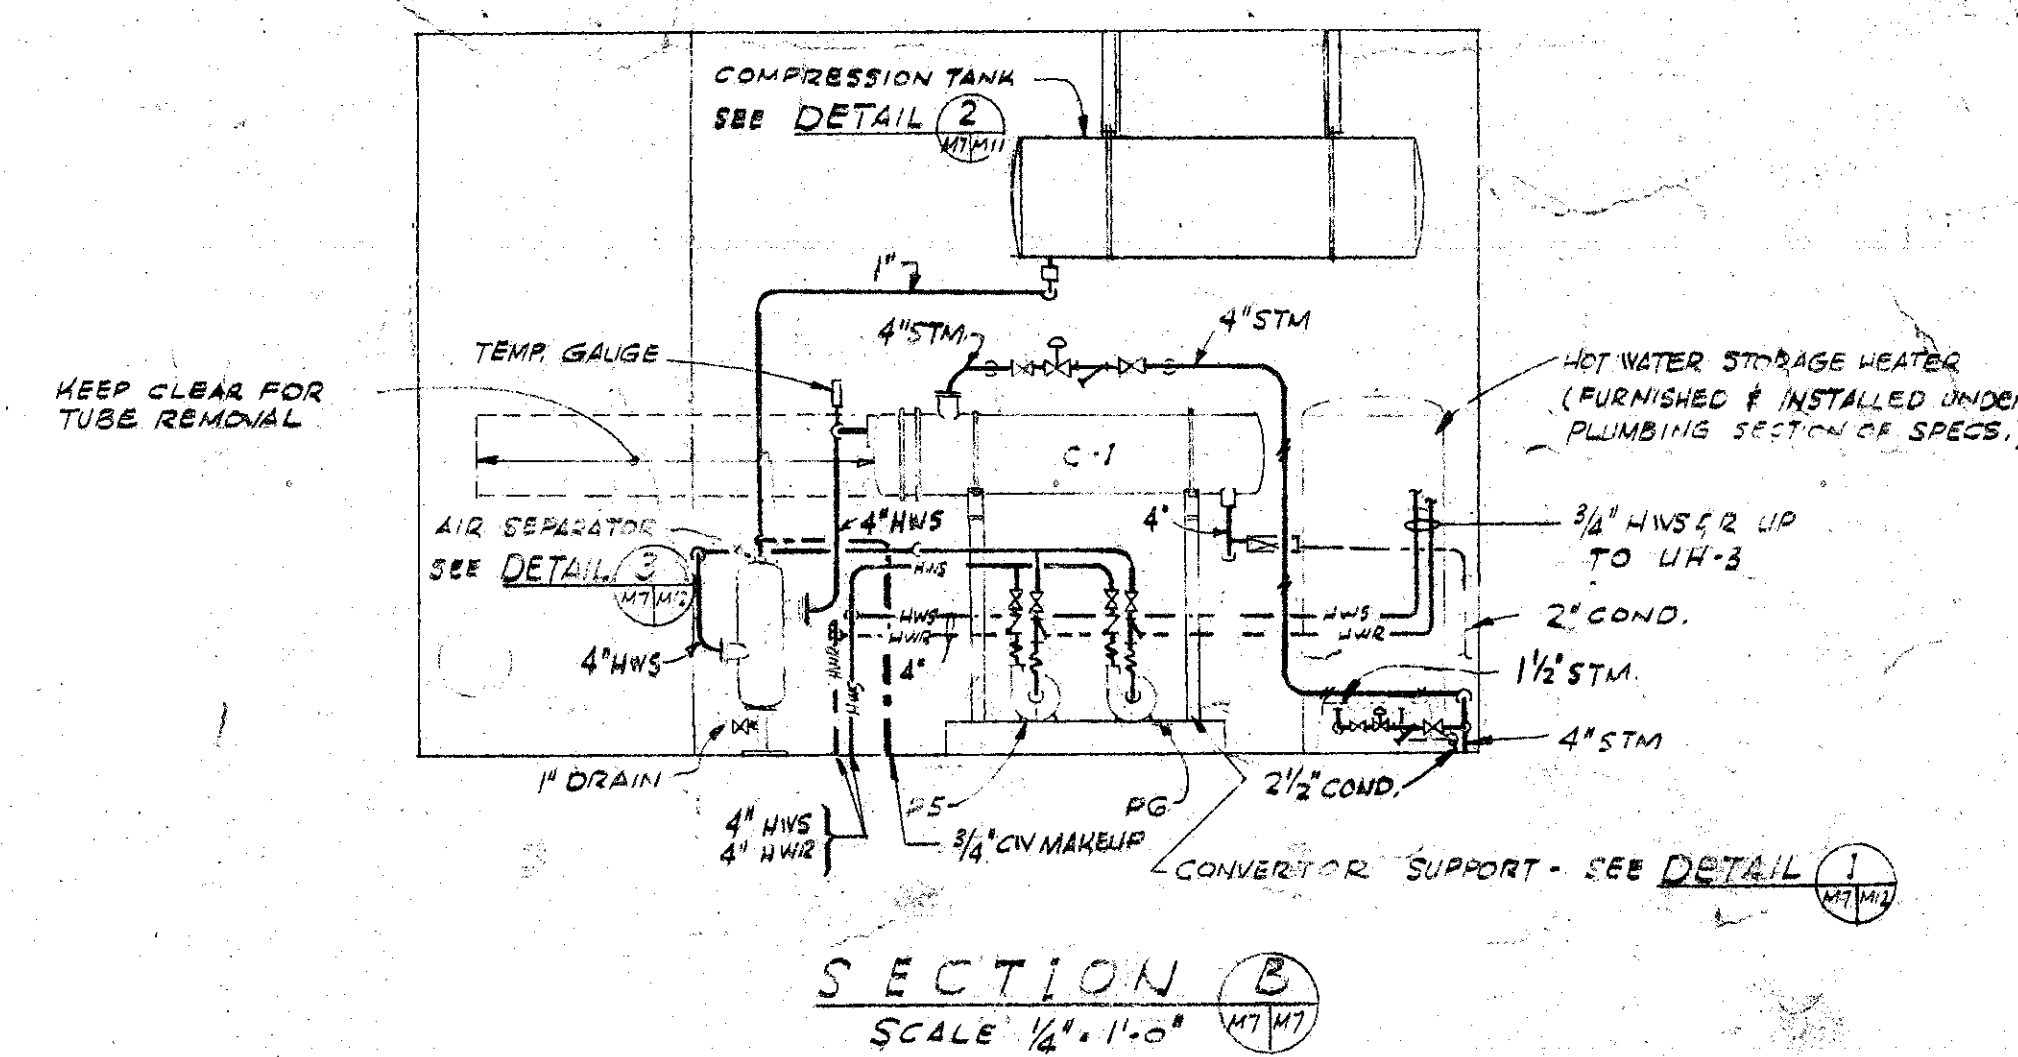
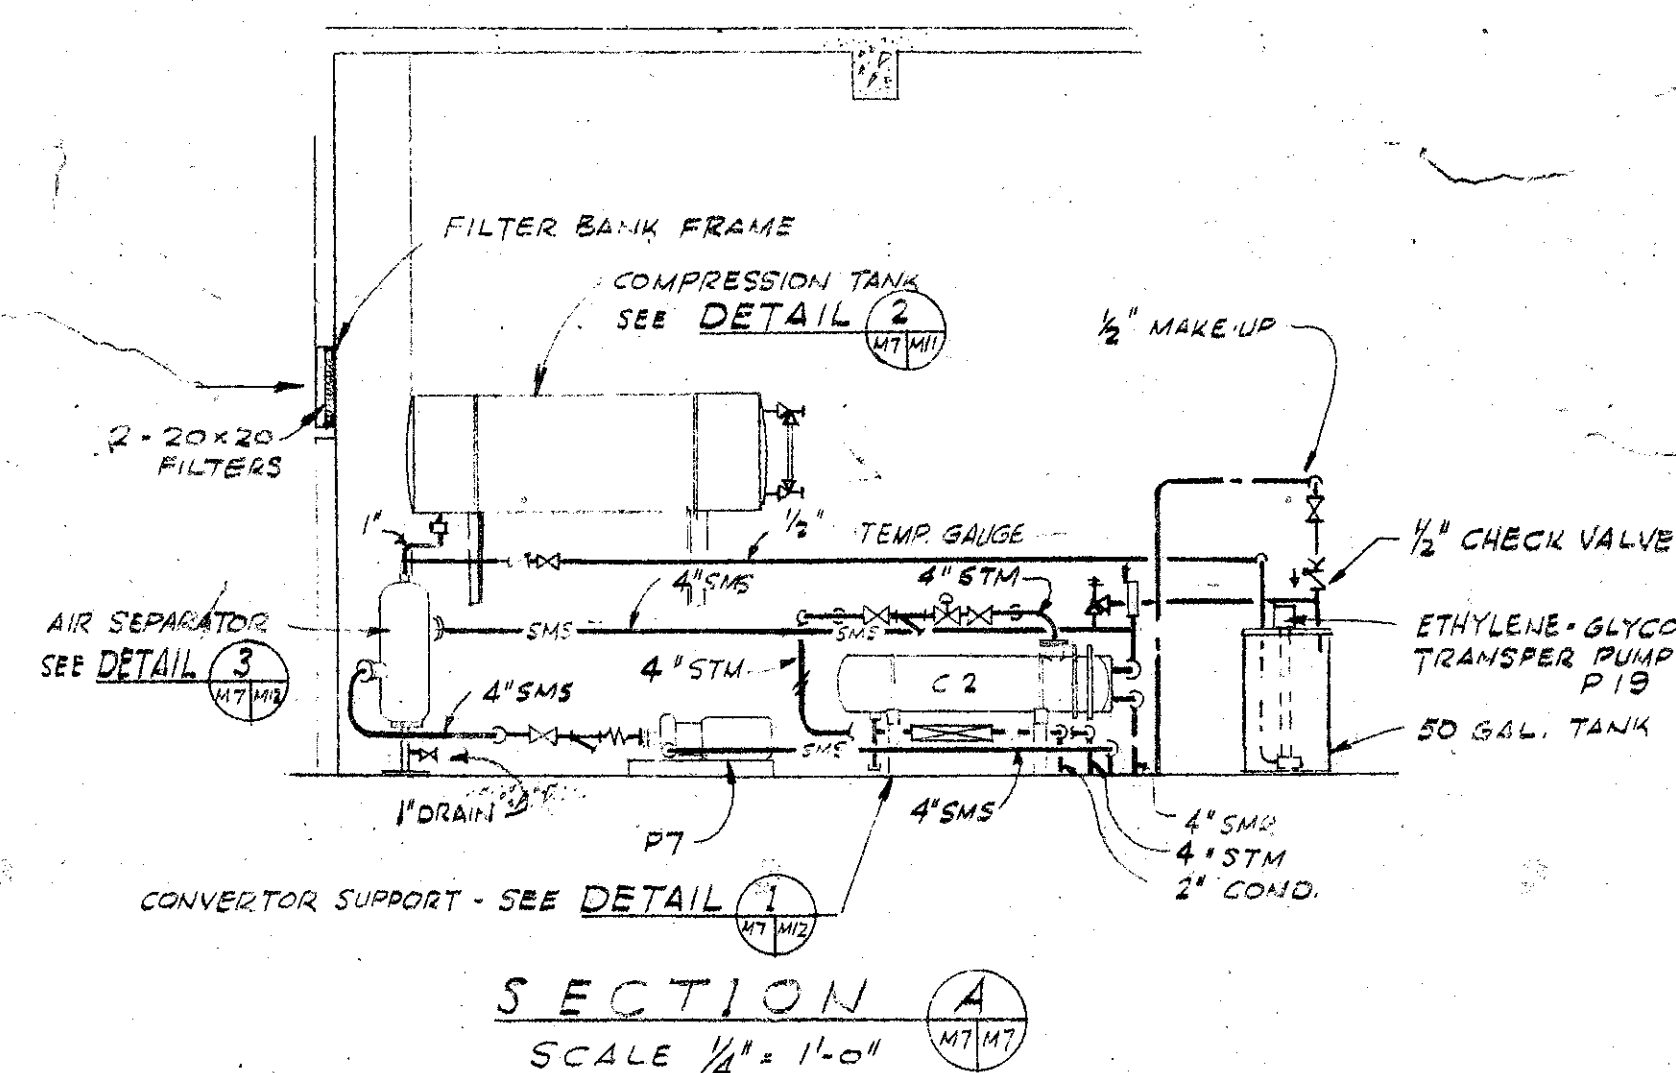


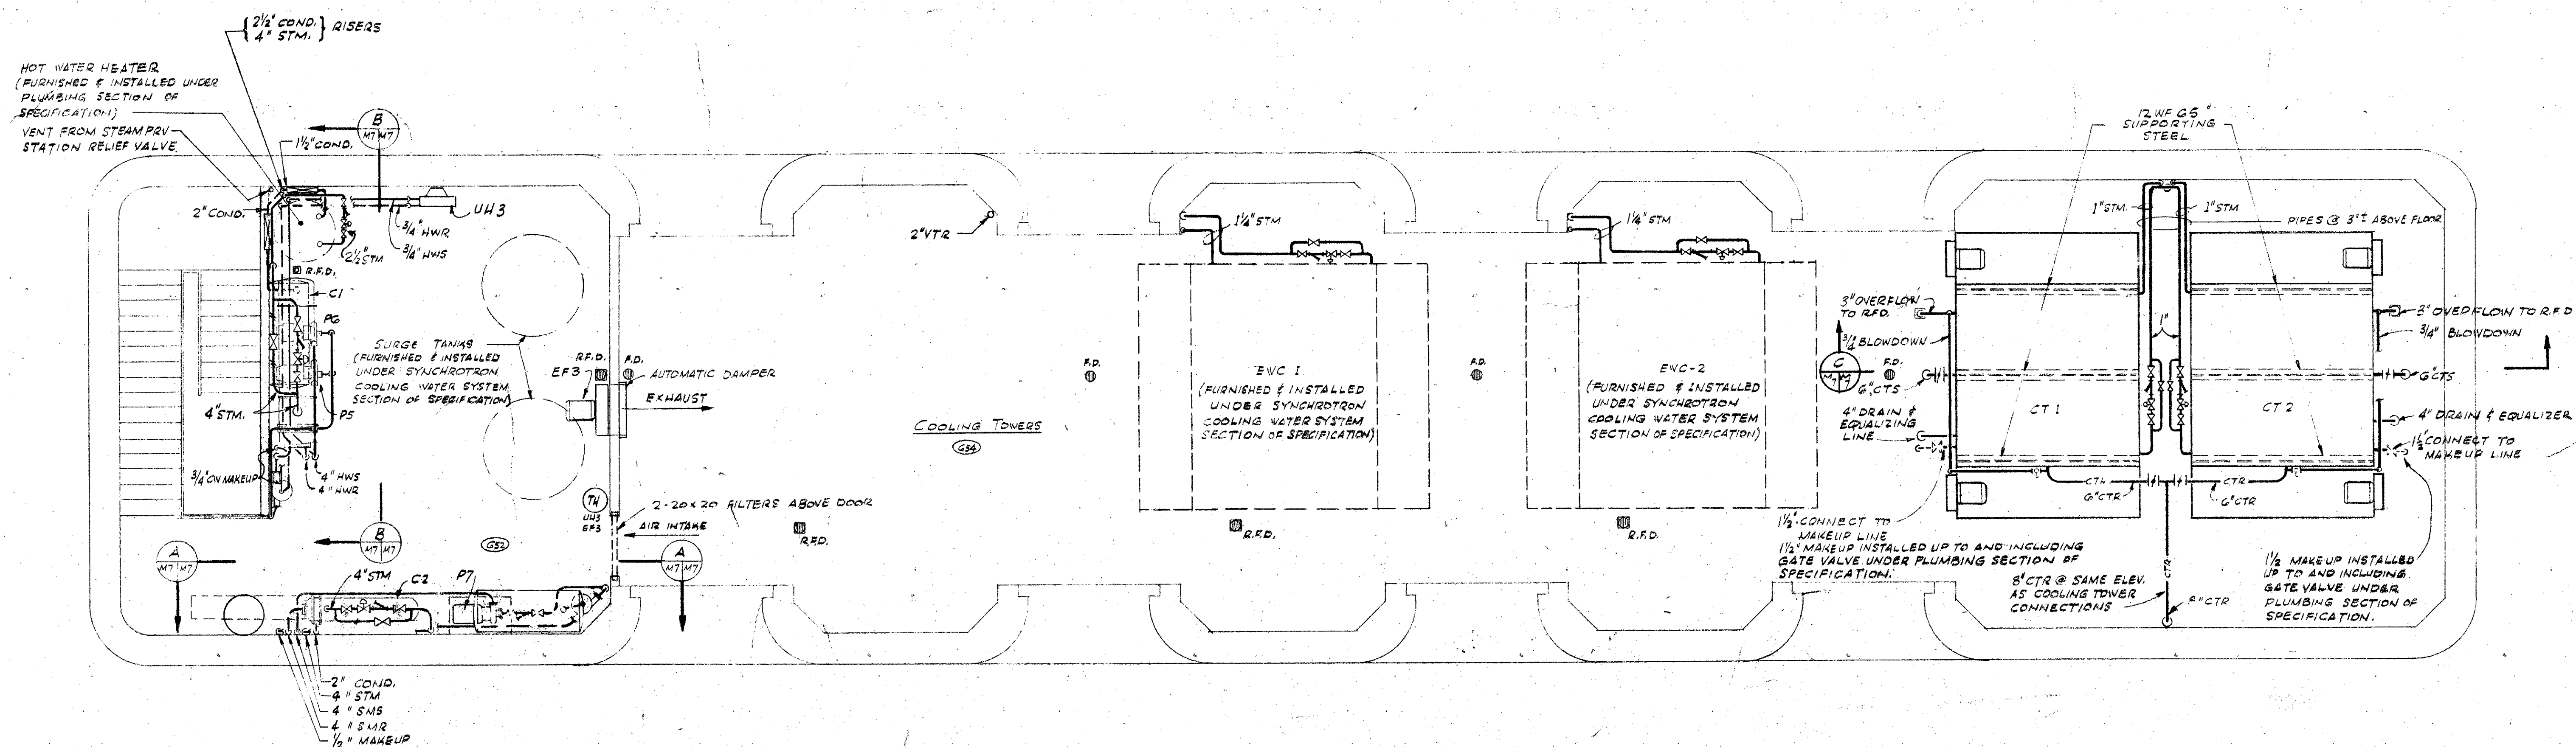

NOTE

1. FOR EQUIPMENT SCHEDULE AND LEGEND REFER TO DWG. M-1
2. REFER TO FLOW DIAGRAMS DWGS MB & MB FOR ALL VALVES, GAGES, ETC. REQUIRED IN PIPING.

LTR	REVISIONS	DATE	CHKD	APPD
		BY	APPD	

IO GEV CORNELL
 SYNCHROTRON LABORATORY

CORNELL

ITHACA

UNIVERSITY

NEW YORK

AIR CONDITIONING

HEATING & VENTILATING

LEVEL #6

PLAN & SECTIONS

WILLIAM M. BROBECK AND ASSOCIATES

IAN MACKNILLY, AIA

PREGNOK & MATHEU

JACOBS ASSOCIATES

950 GILMAN ST.

TELEPHONE

ARCHITECT

STRUCTURAL ENGR.

CONSTRUCTION-ENGR.

BERKELEY, CALIF. 94710

415 - 524 - 8664

DR. ROSSGL	CHK. <i>W. H. Clark</i> SUPV. <i>W. H. Clark</i>	SCALE	<i>NOTED</i>
RELEASED	APPROVED	SHEET	OF
<i>T. H. Clark</i>	LAB. NUCLEAR STUDIES	53	102
Y.P.-BUSINESS <i>W. H. Clark</i> DATE NOV. 16, 1956		DRAWING NO. M 7	
DATE NOV. 16, 1956		WMB & NO. 111-1	

1" =

2085-33-05-209
044
254 Cornell University B. & P.