




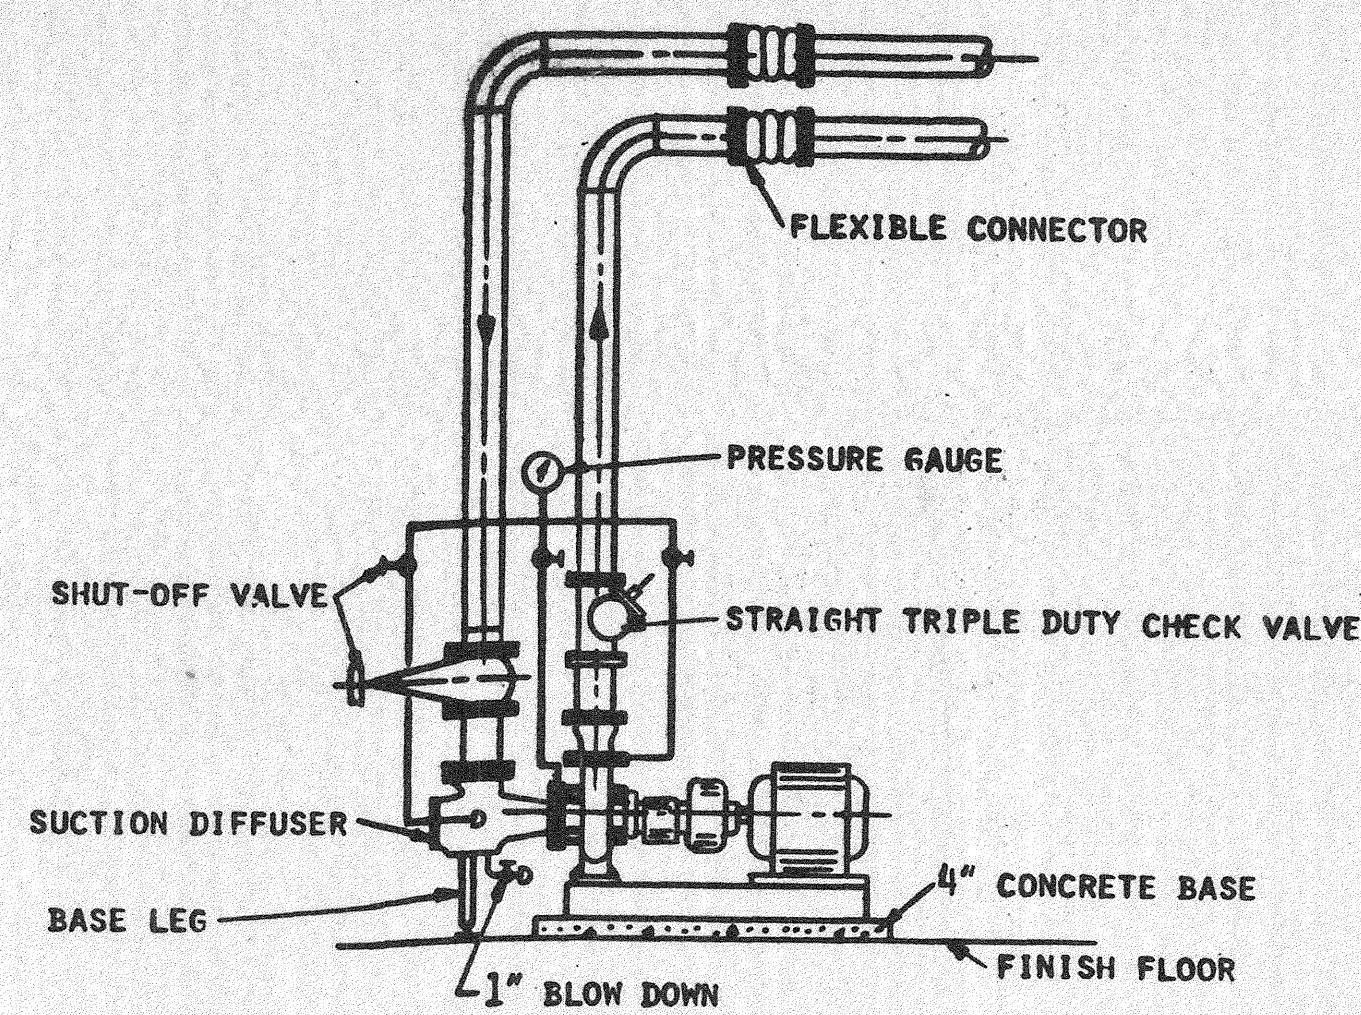


FLOOR MOUNTED PUMP PIPING DETAIL
NO SCALE

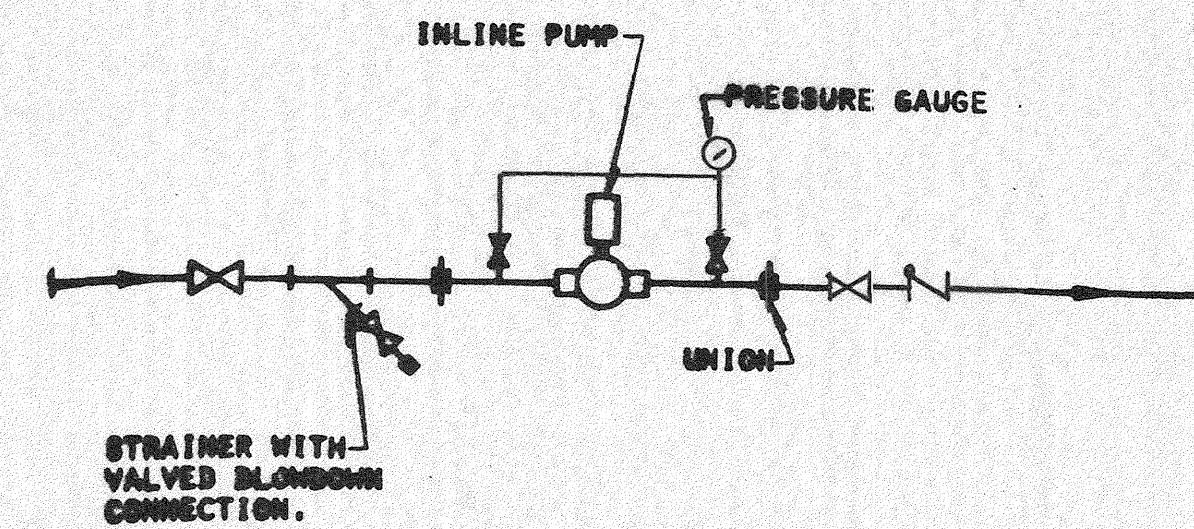


INLINE PUMP DETAIL
NO SCALE

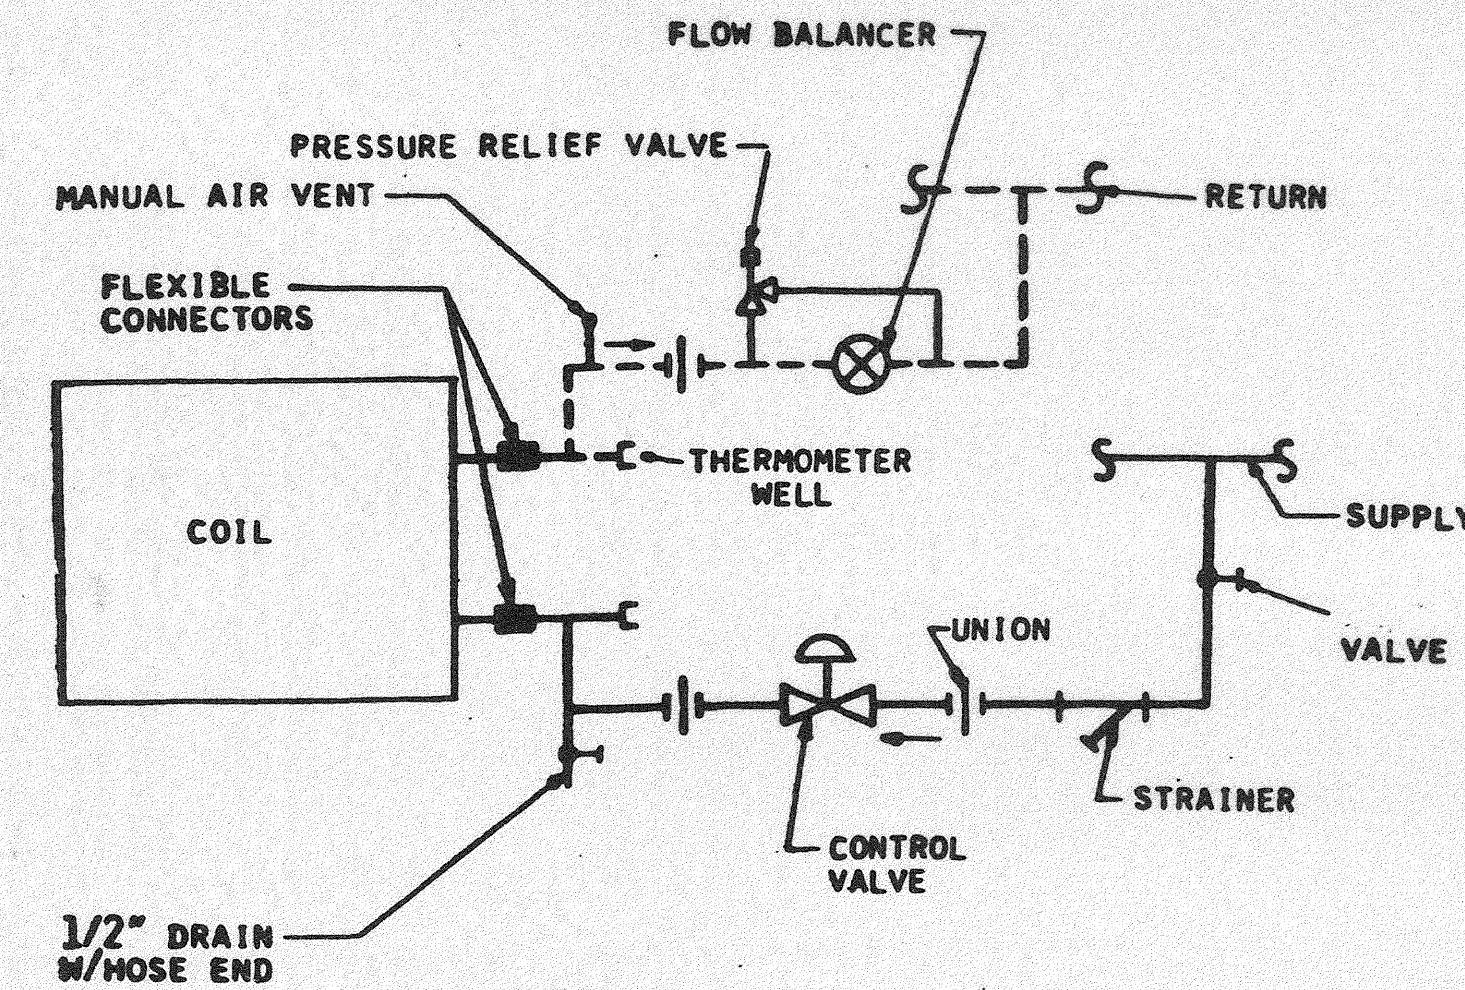


F&C UNIT COOLING COIL PIPING DETAIL
NO SCALE
1. ARRANGE PIPING TO ALLOW REMOVAL OF COIL AND FILTER WITHOUT REMOVING PIPING BEYOND UNIONS.
2. A UNIT MAY BE FURNISHED WITH MORE THAN ONE COIL. PROVIDE MANUAL AIR VENT, DRAIN, UNIONS, CONNECTORS, AND FLOW BALANCER FOR EACH COIL.

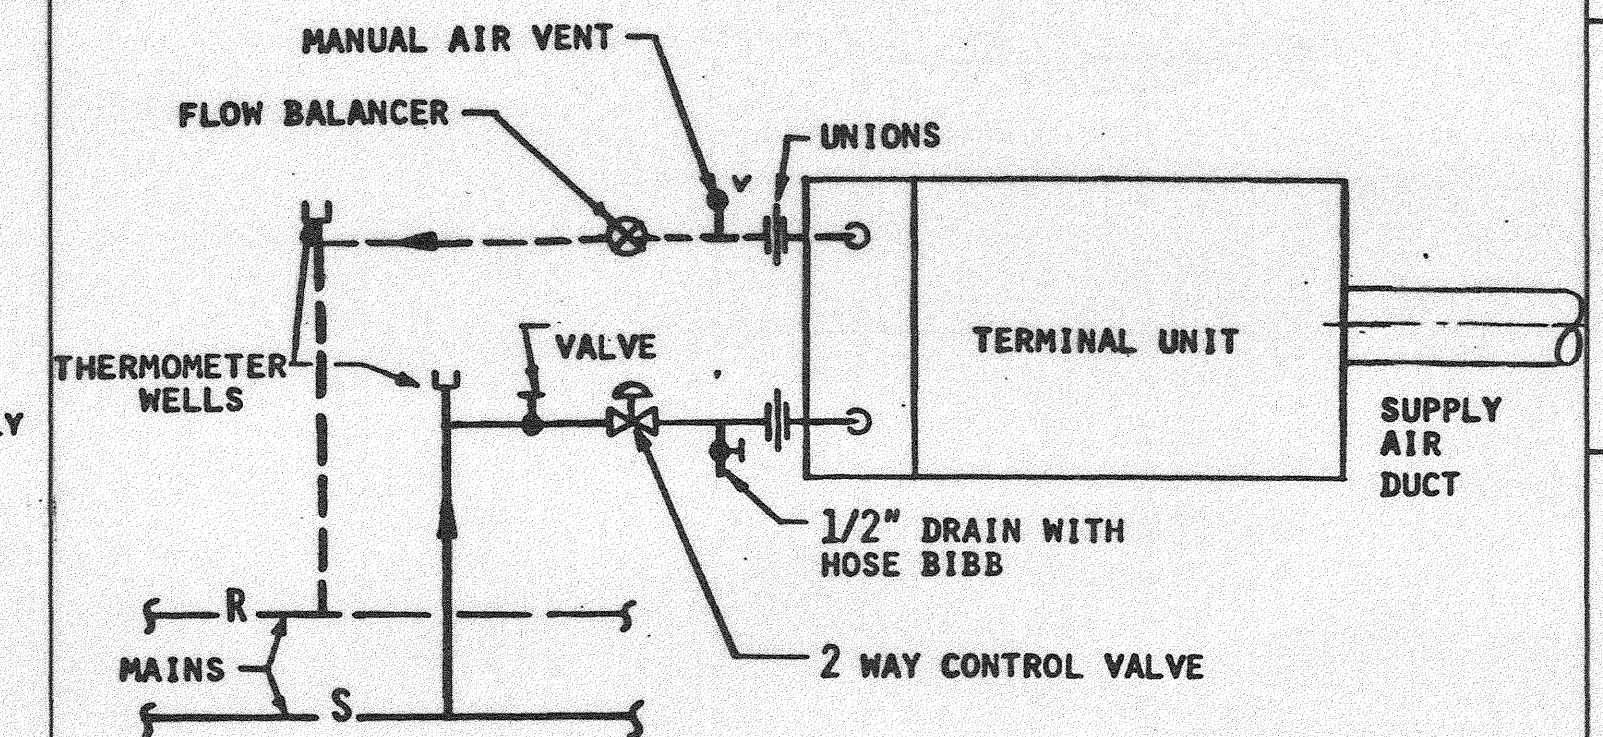


TERMINAL REHEAT UNIT DETAIL
NO SCALE
1. TAKE RUNOUTS OFF BOTTOM OF MAINS WHERE MAINS ARE ABOVE TERMINAL UNIT.

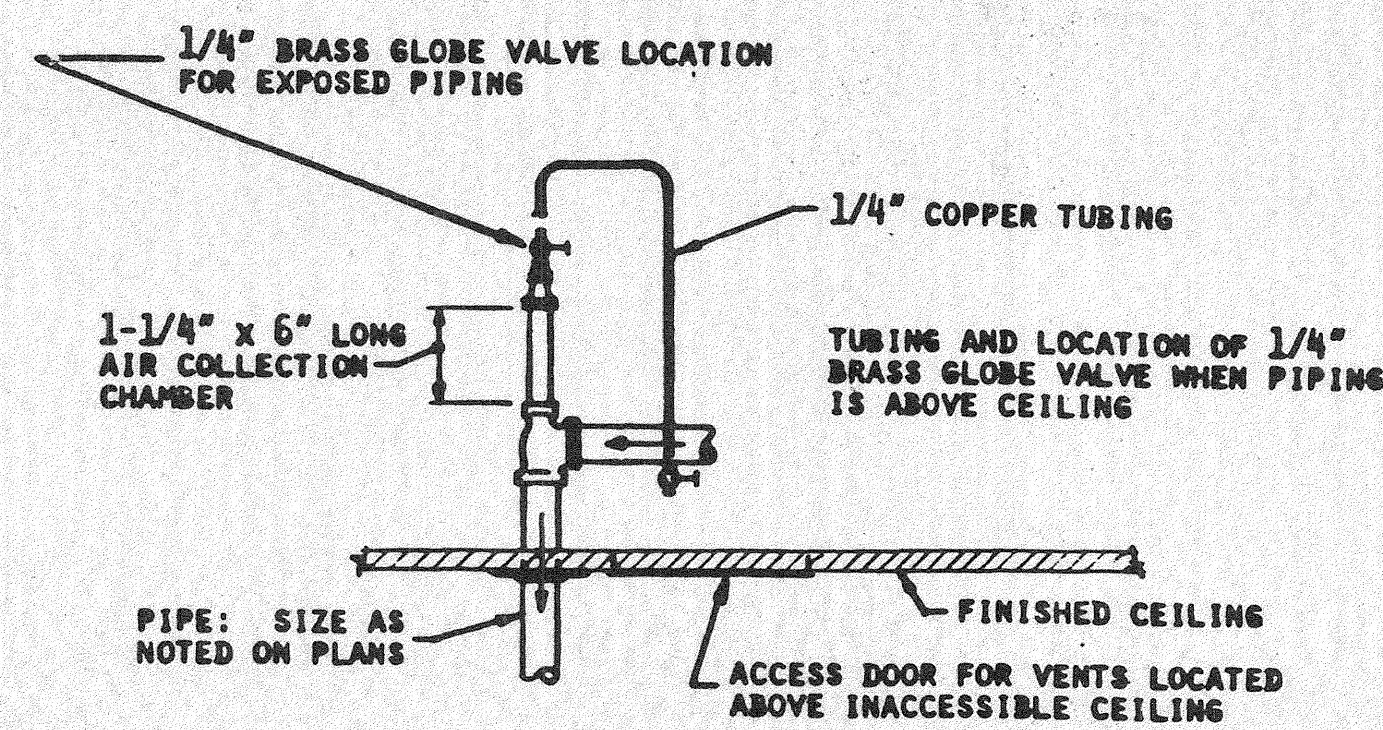


MANUAL AIR VENT DETAIL WATER PIPING
NO SCALE
SYMBOL INDICATED ON DRAWING

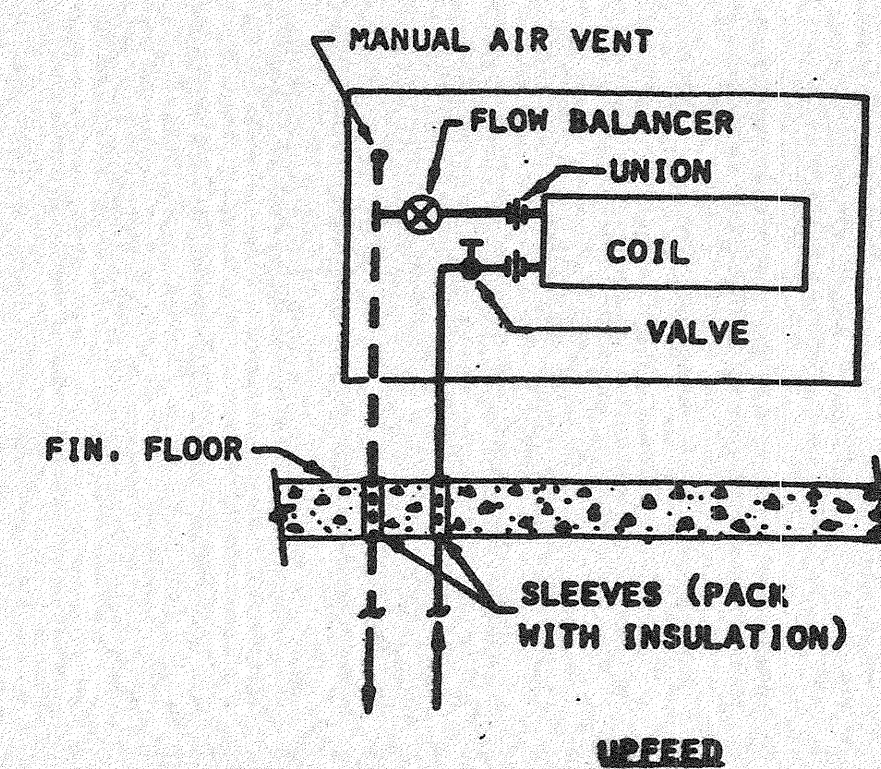

CABINET UNIT HEATER PIPING DETAIL
NO SCALE
1. PIPING FOR DOWN FEED UNITS IS SIMILAR.

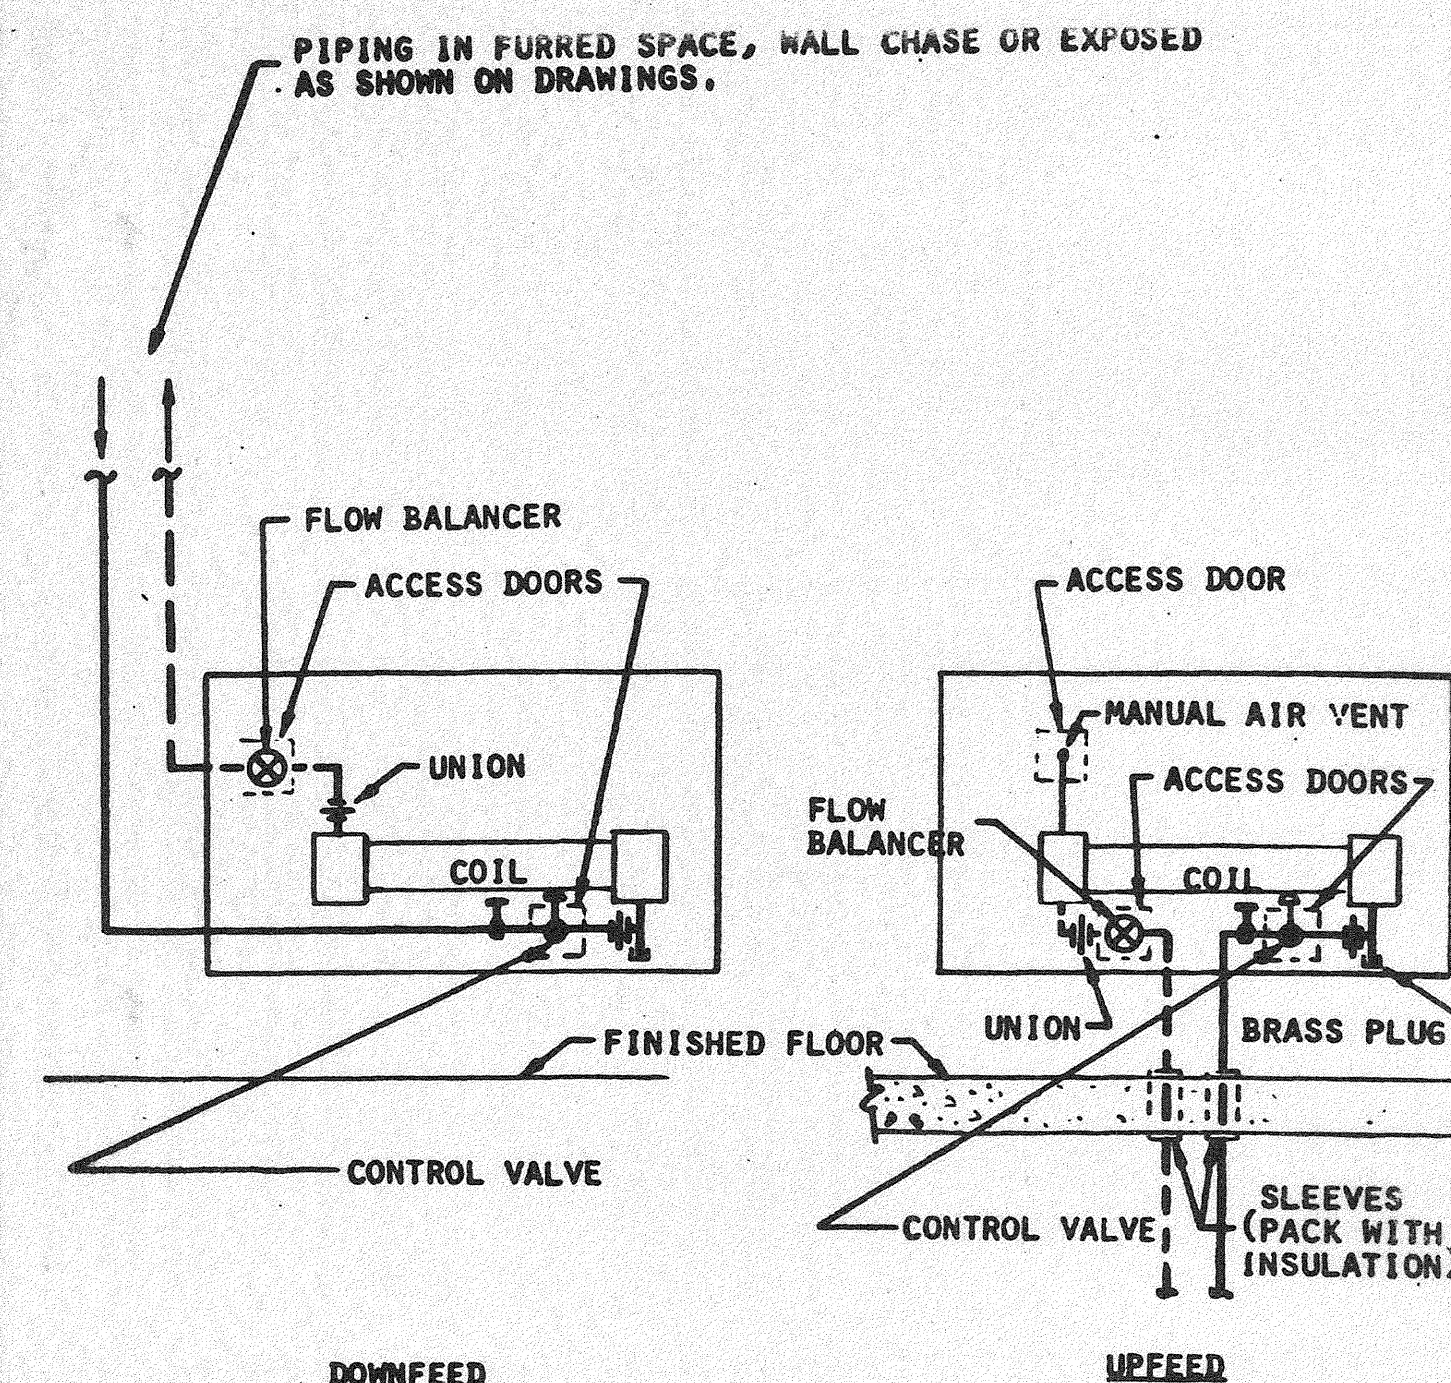

CONVECTOR PIPING DETAILS
NO SCALE
1. OMIT ACCESS DOORS ON SURFACES MOUNTED CONVECTORS. MAKE VALVES ACCESSIBLE FROM BELOW UNIT.
2. ACCESS DOORS ARE NOT REQUIRED ON CONVECTORS WITH HINGED TYPE MOUNTING OF CABINET FRONT PANEL.

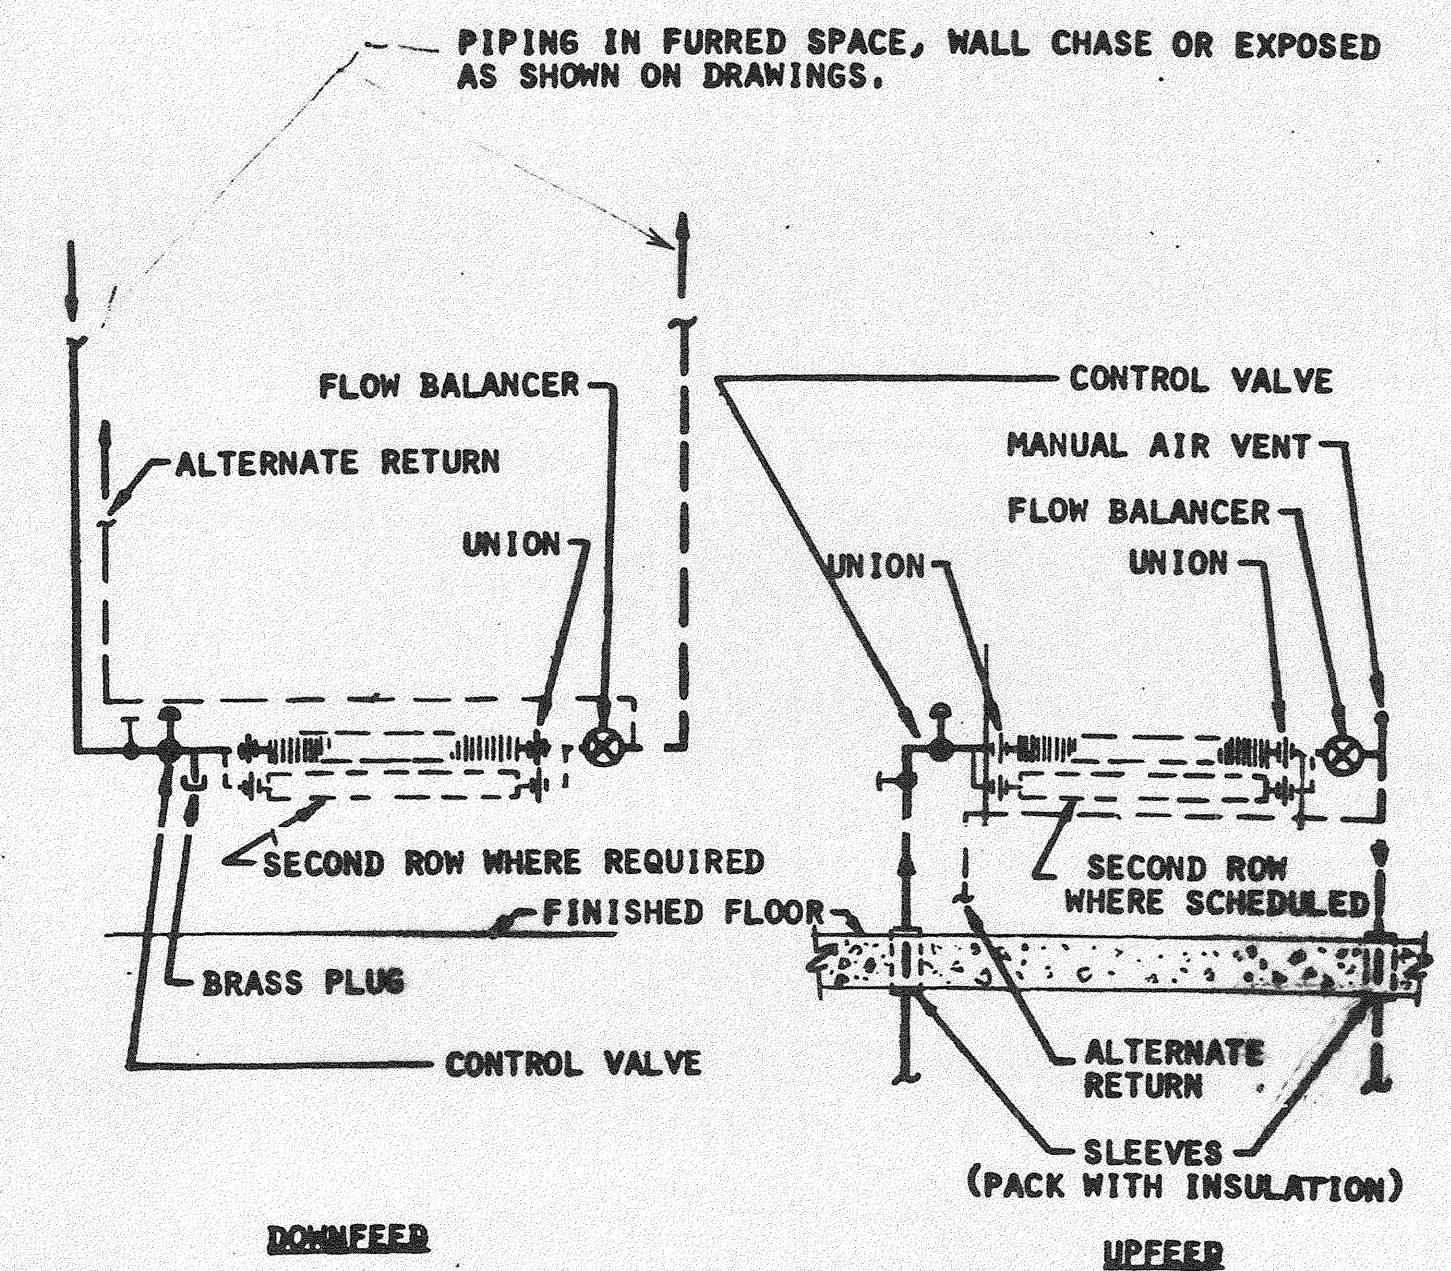

FIN RADIATION PIPING DETAILS
NO SCALE