




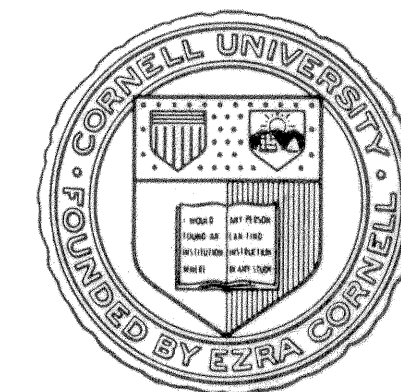


APPROVAL	DATE
<i>Philip & Co</i>	8/8/89
FACILITIES ENGINEERING	
LIFE SAFETY	
DRAWN BY	DATE
P.K.	8/8/89
CHECKED BY	
ARCH <i>AK</i>	ENERGY
CIVIL <i>AK</i>	ENVIR
ELEC <i>AK</i>	
MECH <i>LACS</i>	
STRUCT	


REV	DATE	BY	DESCRIPTION

DRAWING TITLE
LOE MEZZANINE

PROJECT
CESR COOLING TOWER REPLACEMENT
LOCATION NO.
2085

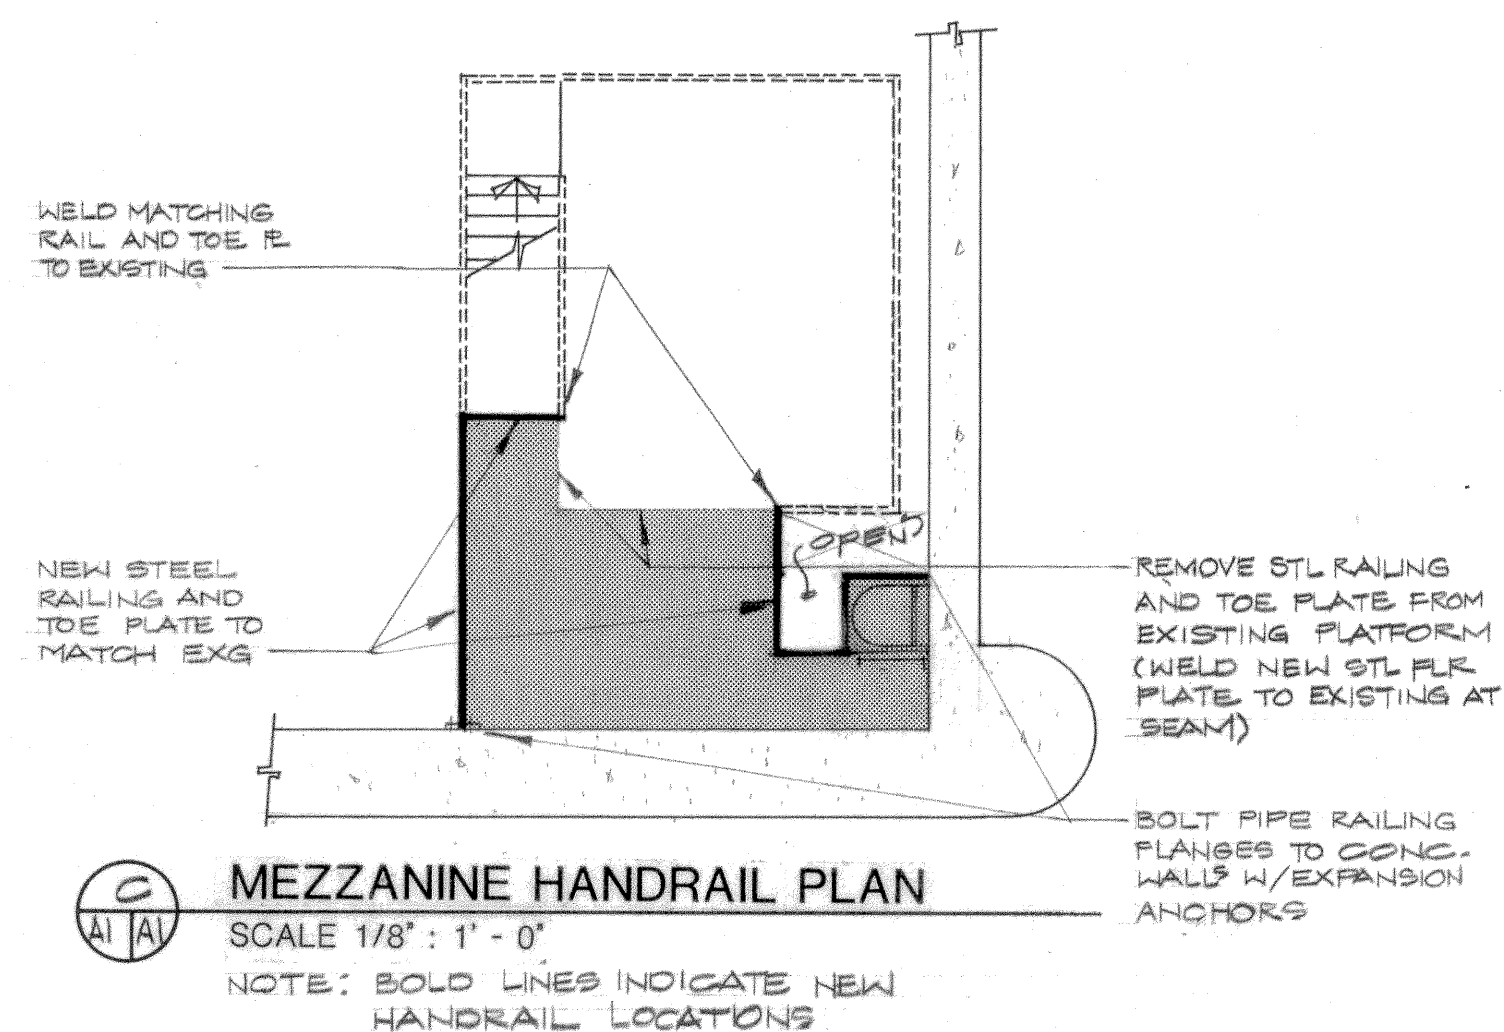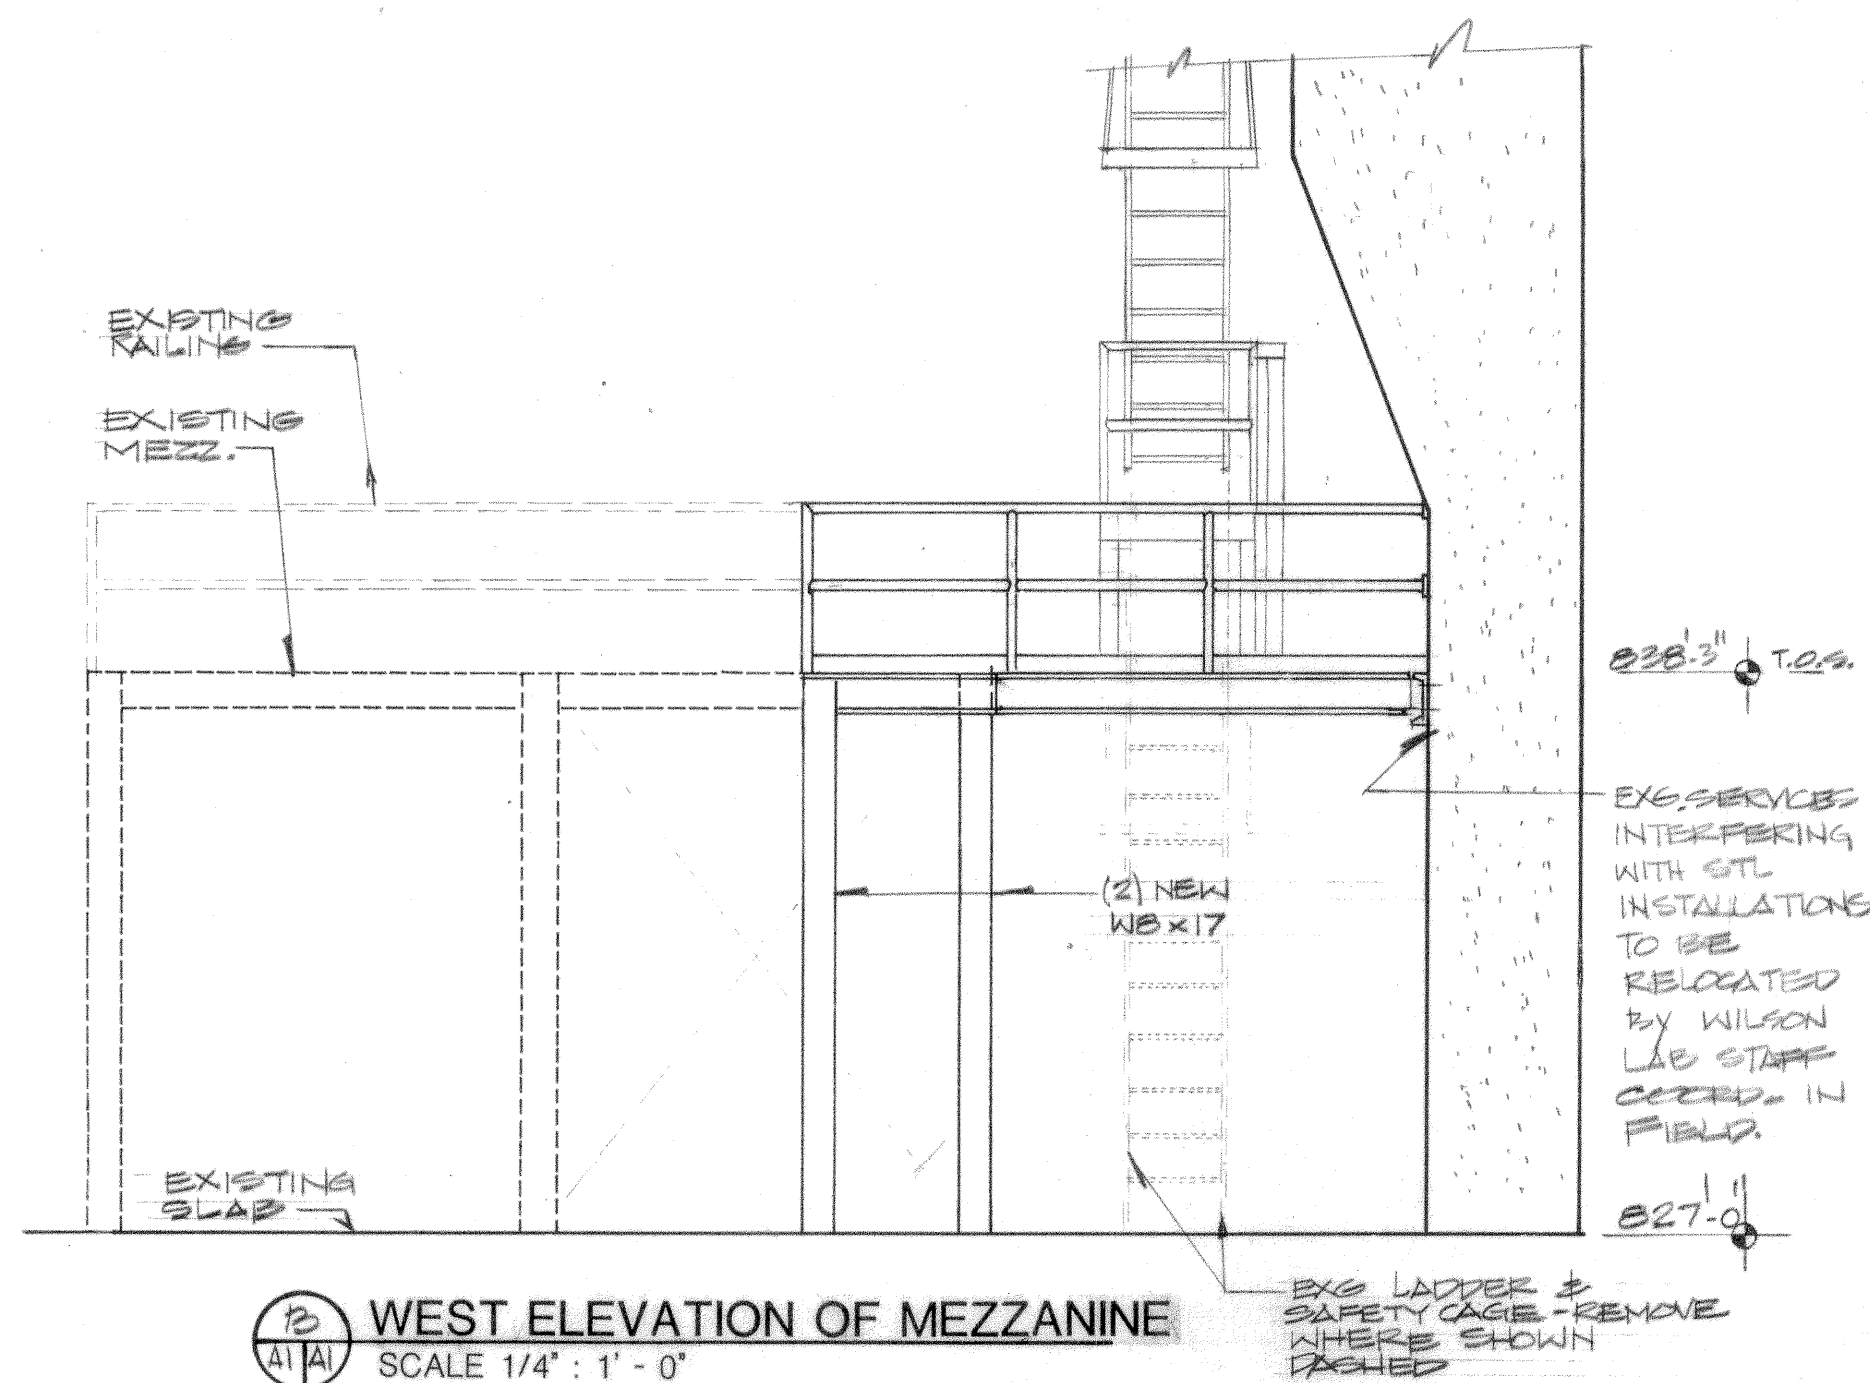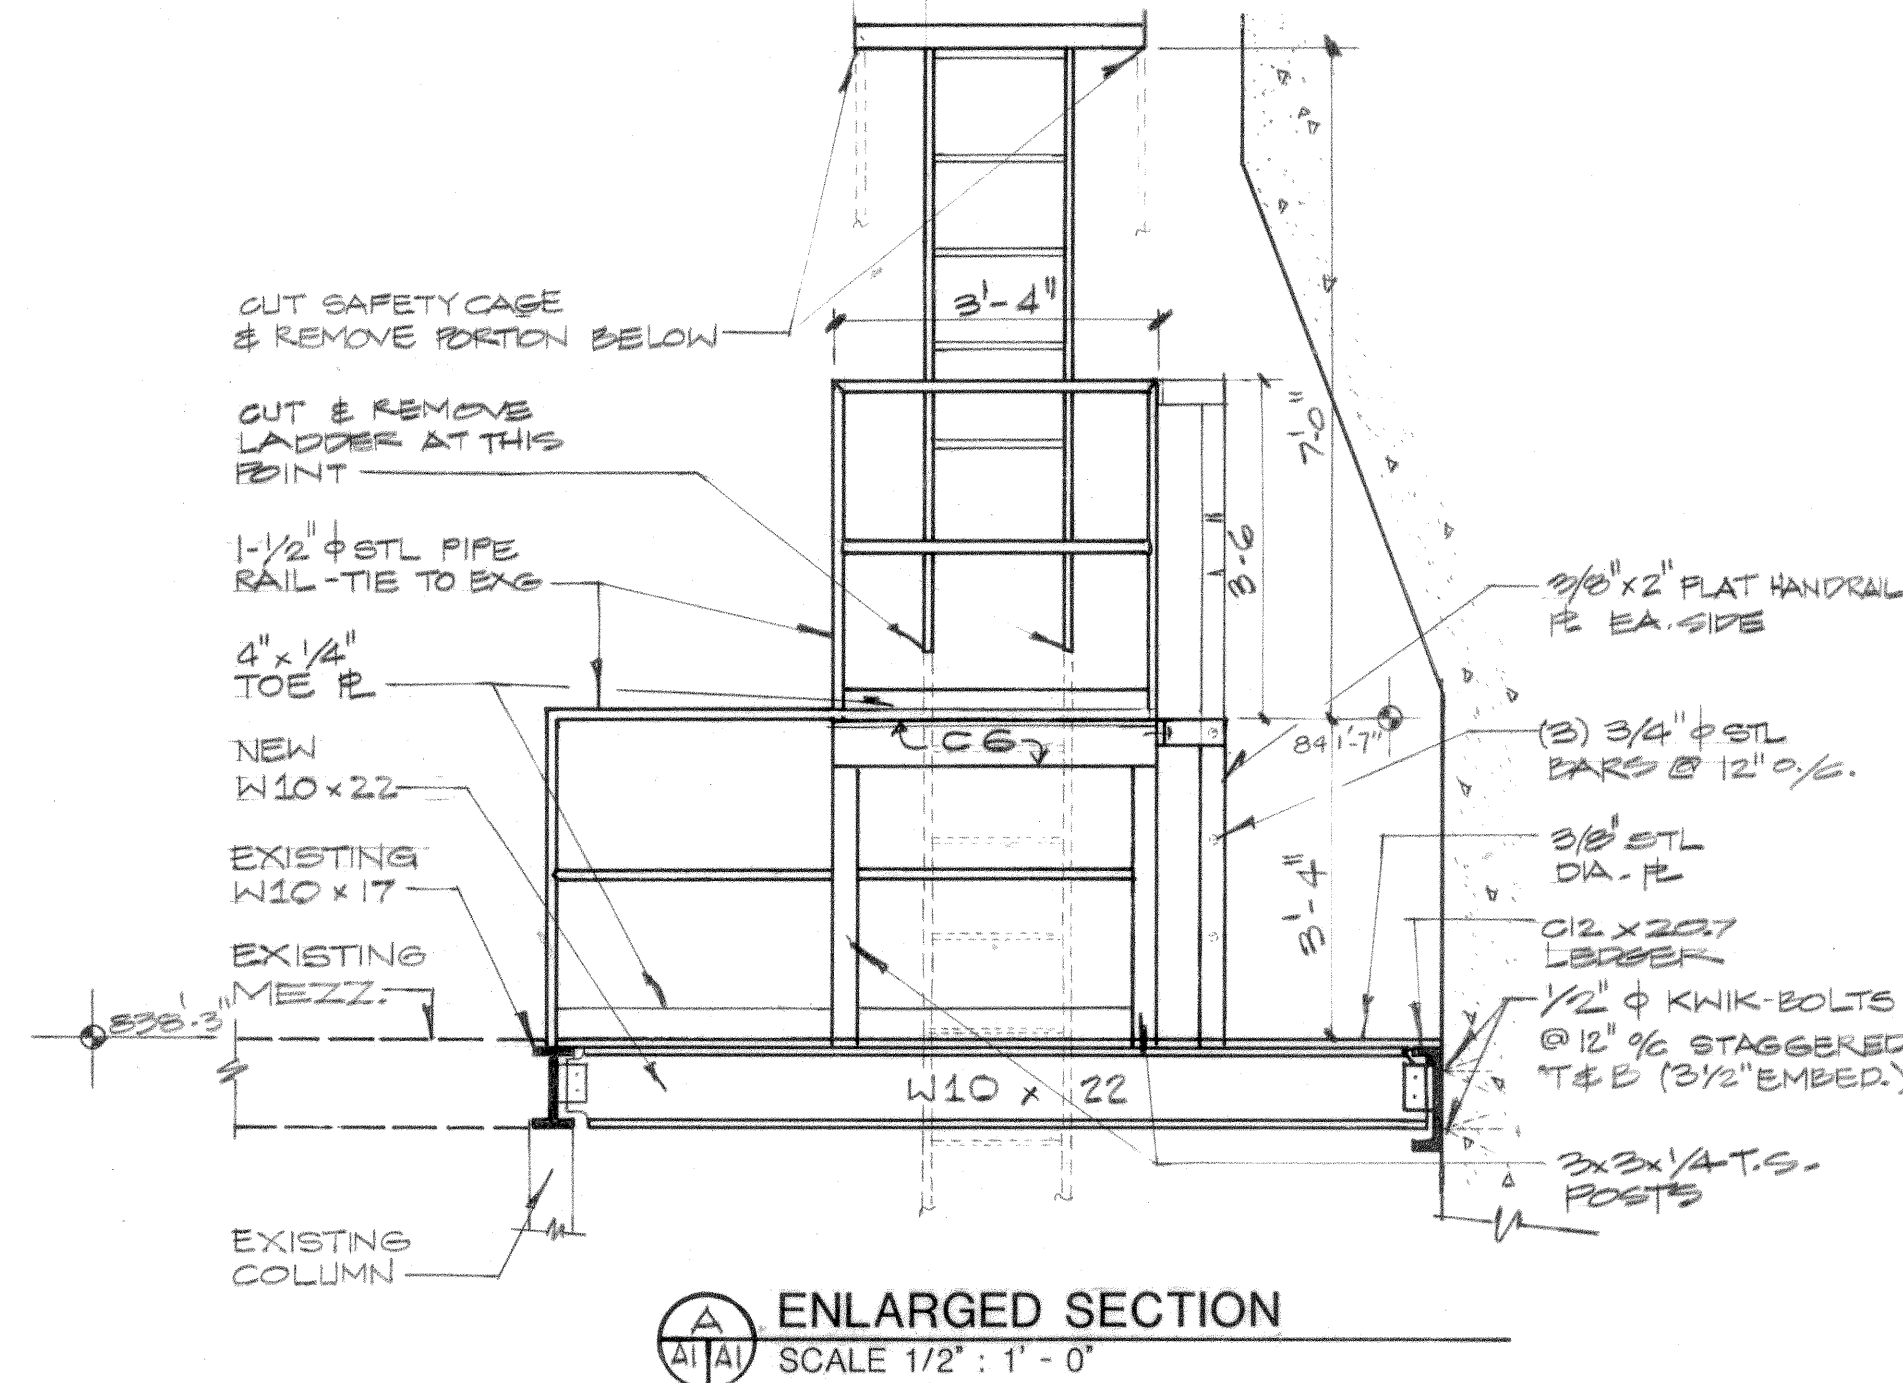



MEZZANINE HANDRAIL PLAN
SCALE 1/8" : 1' - 0"
NOTE: BOLD LINES INDICATE NEW HANDRAIL LOCATIONS

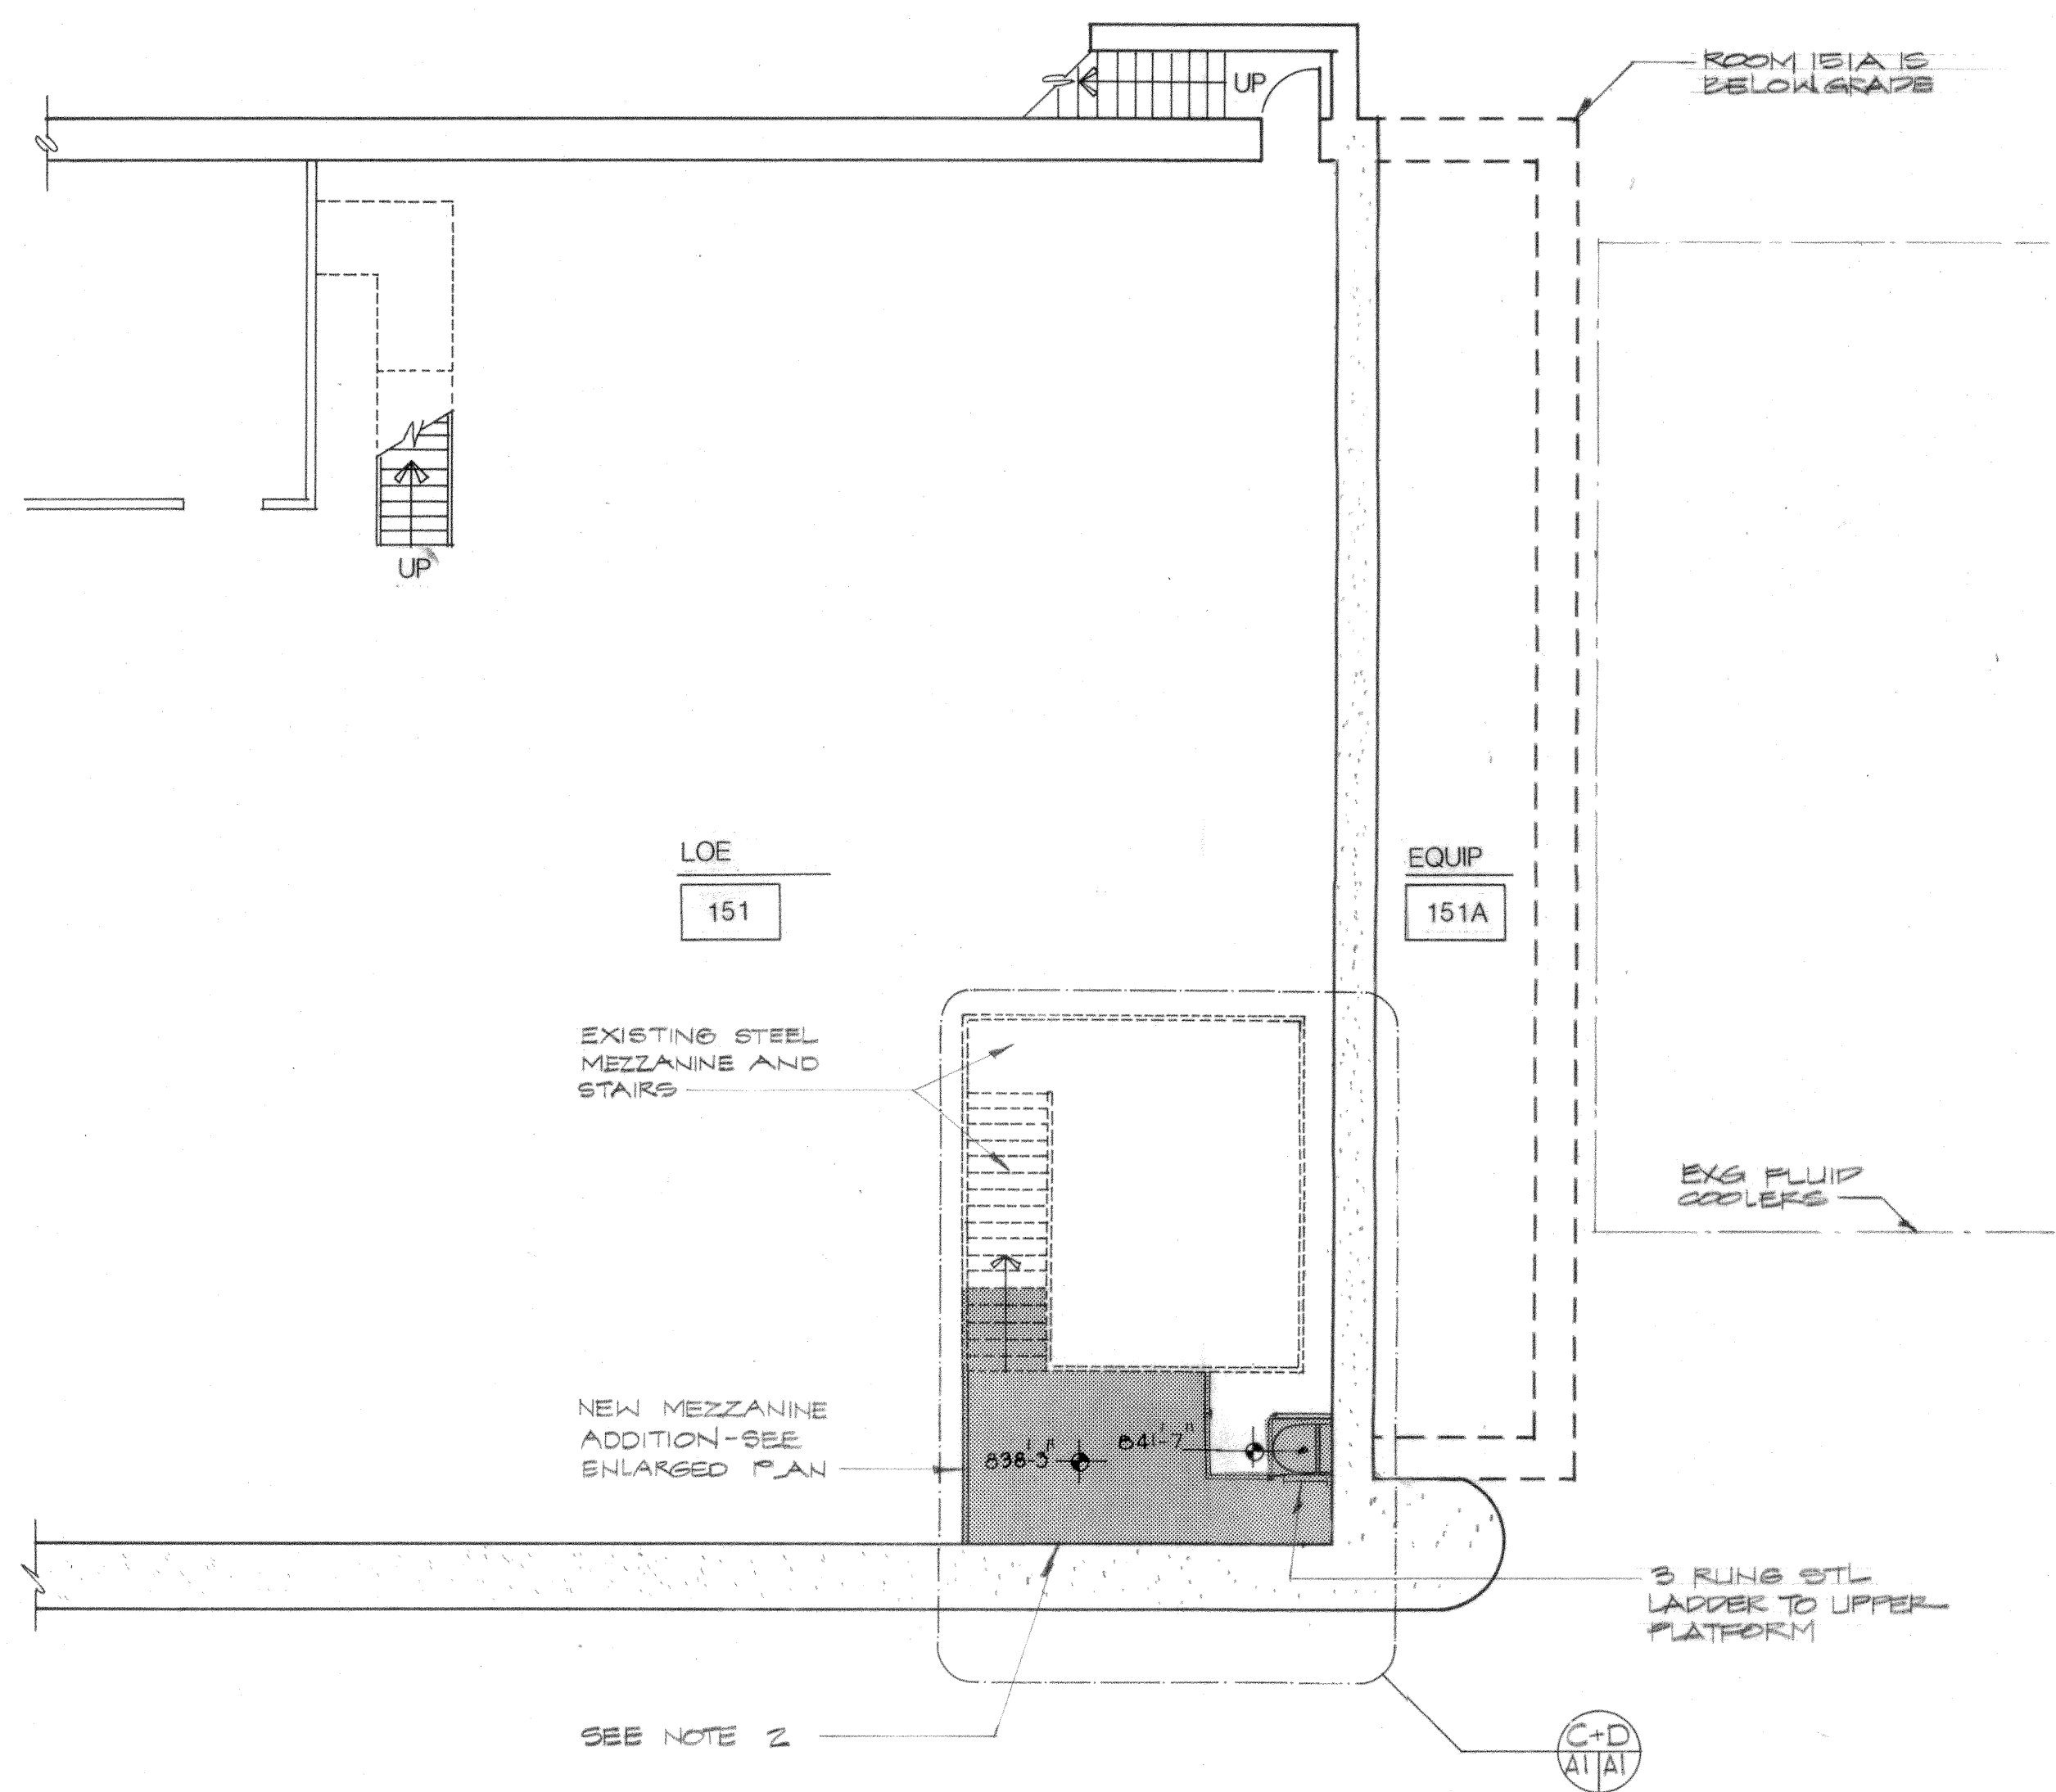

PARTIAL LOE FLOOR PLAN AND SITE PLAN
SCALE 1/8" : 1' - 0"

GENERAL NOTES:

1. MINIMIZE FIELD WELDING WITHIN LOE. WHERE FIELD WELDING IS REQUIRED, PROVIDE FIRE RETARDENT DROP CLOTH BELOW NOTIFY LOE REPRESENTATIVE PRIOR TO WELDING OR CUTTING.
2. PROVIDE A CONTINUOUS CAULK BEAD AT JUNCTION OF STL FLR PLATE AND LOE SOUTH & EAST WALL.
3. ANY PENETRATIONS THROUGH THE STL FLOOR TO HAVE A WATERSTOP (MATCH EXISTING)

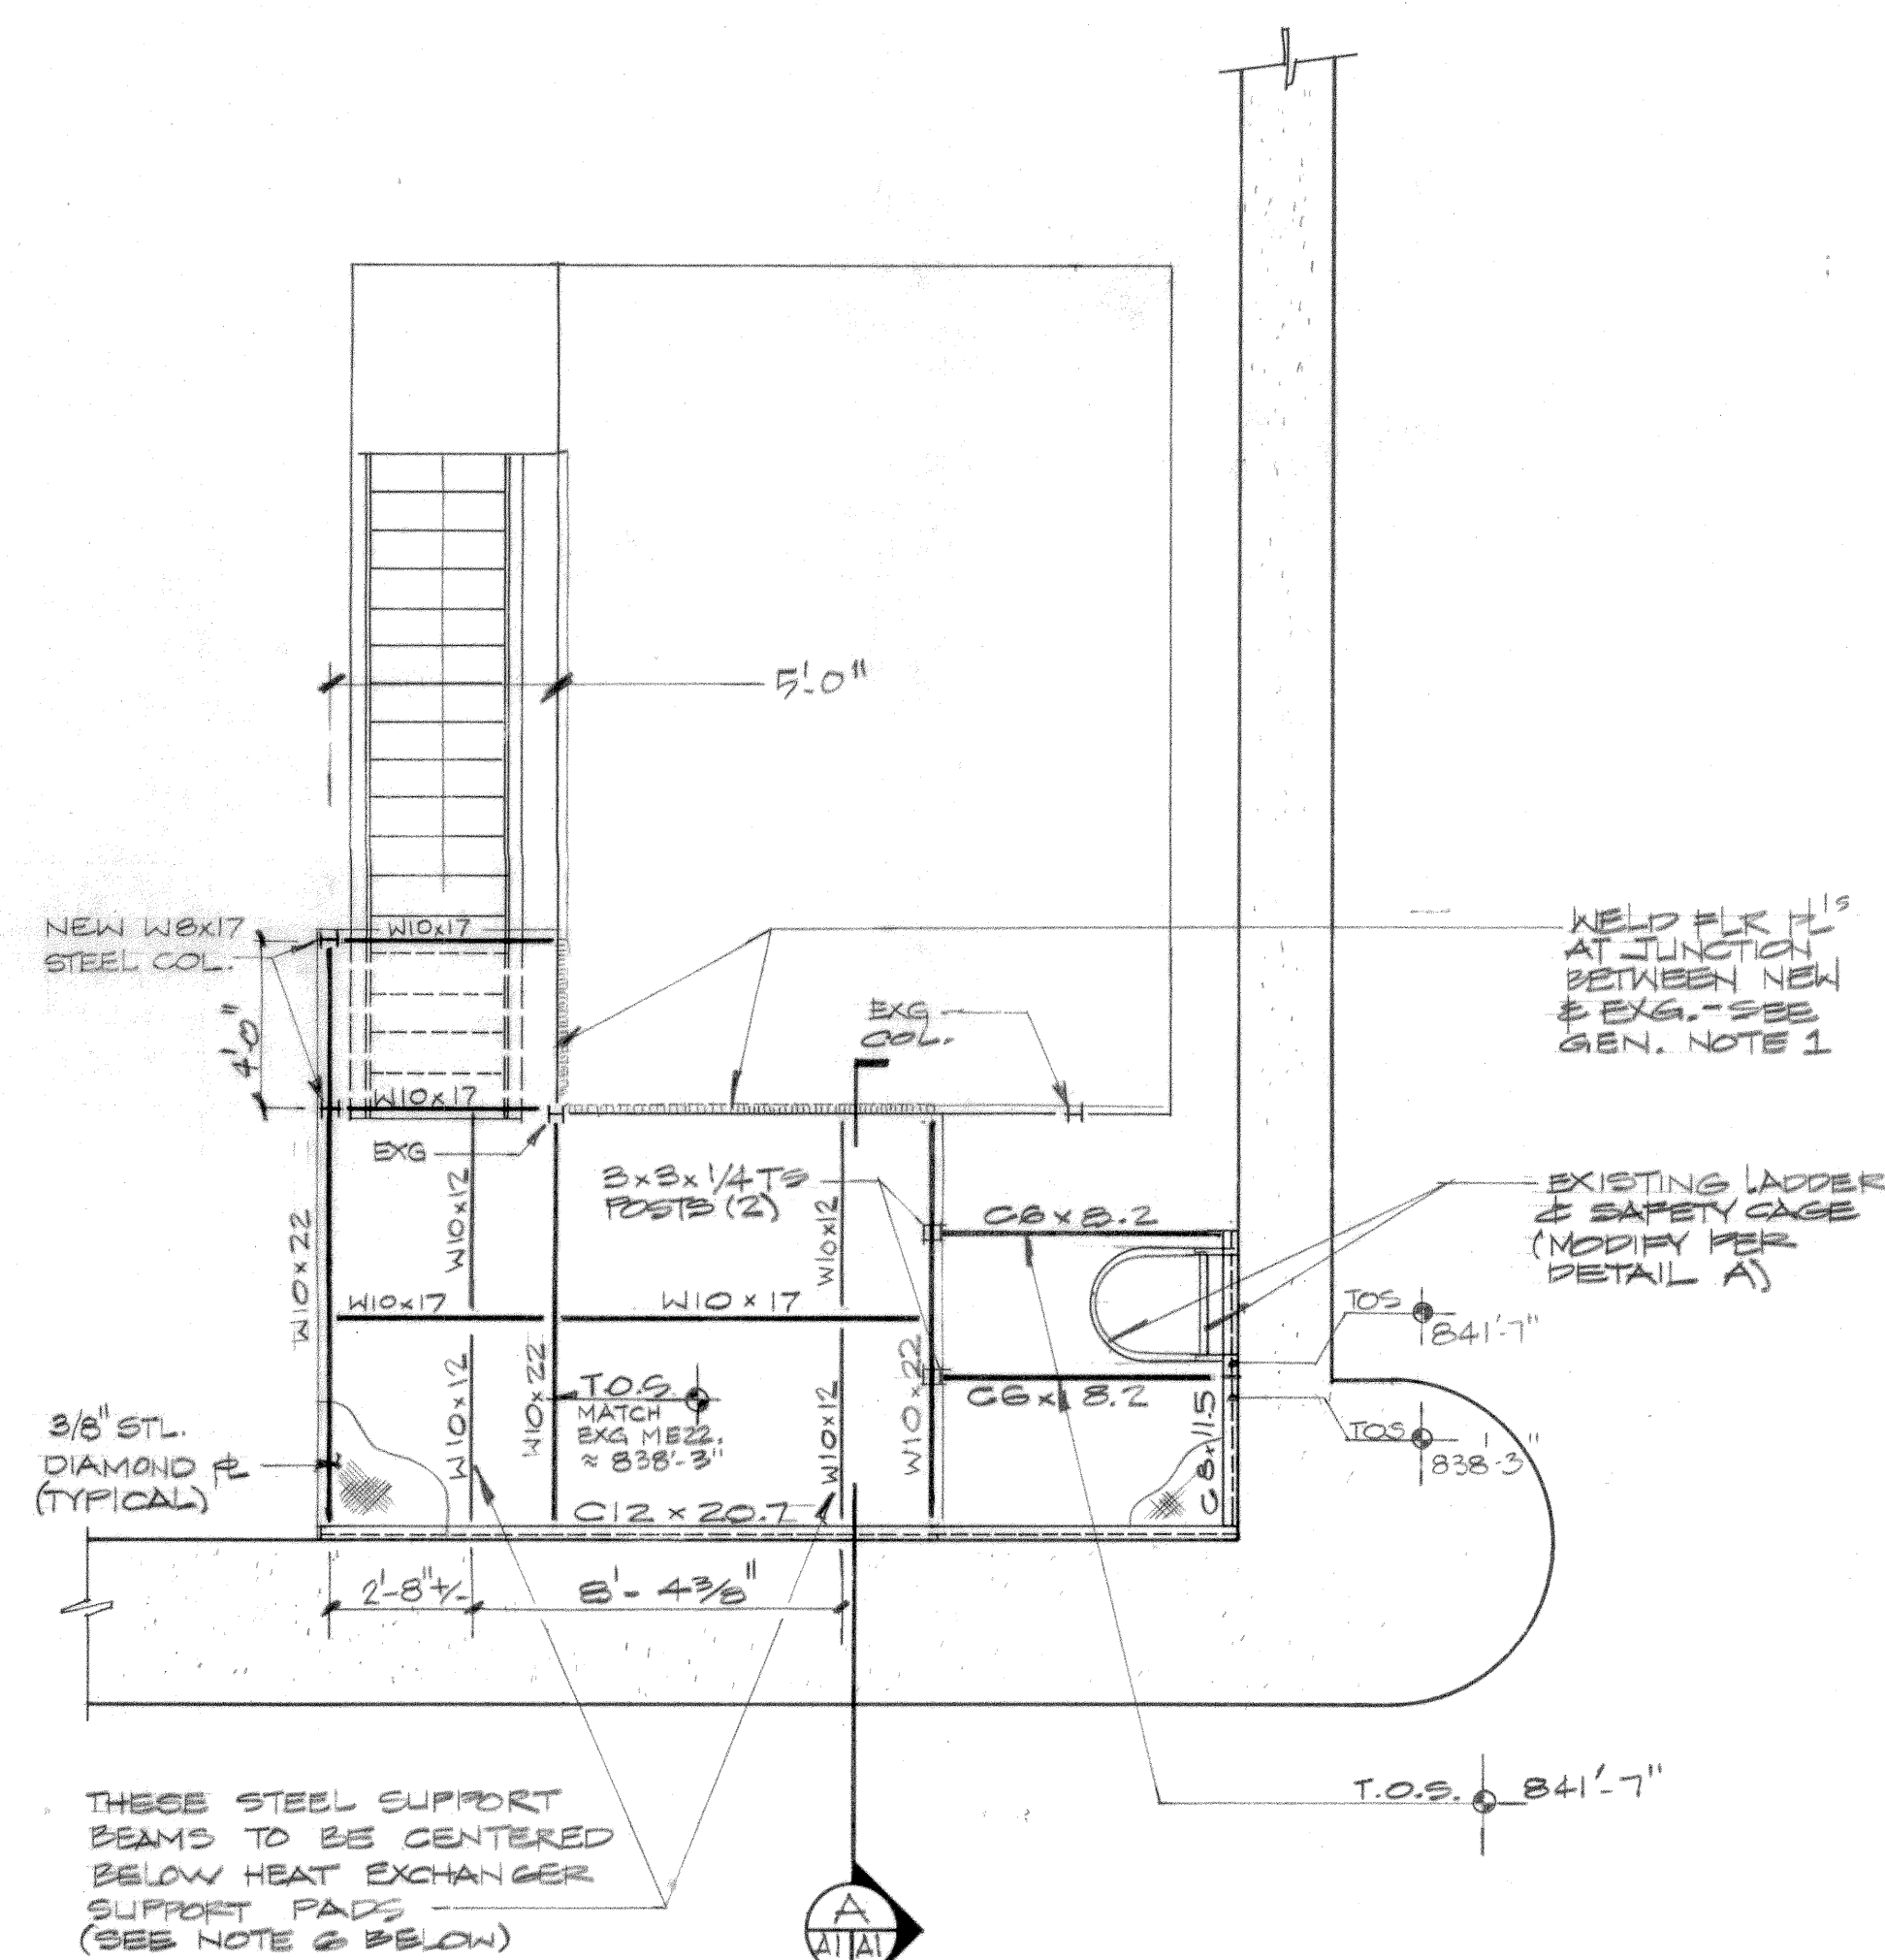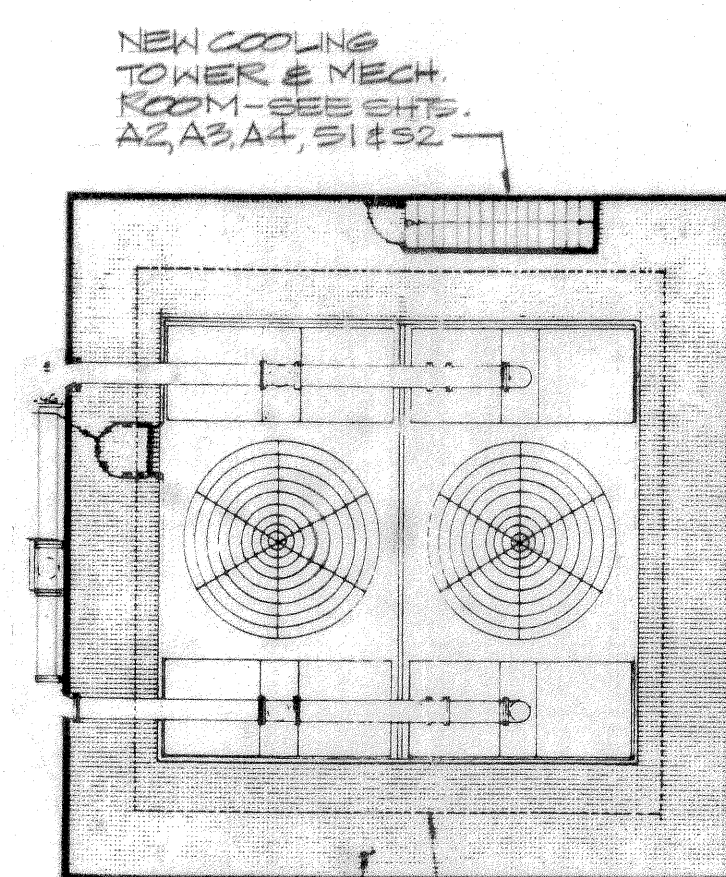

MEZZANINE EXTENSION FRAMING PLAN
SCALE 1/4" : 1' - 0"

NOTES:

1. DIAMOND FLOOR PLATE TO MATCH EXG.
2. WELD PLATE CONTINUOUSLY TO SUPPORT STL.
3. PAINT ALL STEEL TO MATCH EXG.
4. SET NEW COLUMN BASE PLATES ON NON-SHRINK GROUT PADS (THICKNESS TO MATCH EXG.)
5. PROVIDE SHOP DRUGS PRIOR TO FABRICATION
6. STEEL INSTALLATION SHALL BE COORDINATED WITH OTHER TRADES (STEEL SUPPORT LOCATION FOR THE HEAT EXCHANGERS SHALL BE VERIFIED WITH THE APPROVED SHOP DWGS.)

SCALE	SHEET NO.
AS NOTED	A1
FILE NO.	7 OF 20
85610	
DRAWING NO.	
D- 2849	